

Greenport UFSD

Districtwide Lead in Water Testing - 2016



ENVIROSCIENCE
CONSULTANTS INC.

2150 Smithtown Ave., Suite 3, Ronkonkoma, NY 11779

T: 631.580.3191 • F: 631.580.3195 • W: envirohealth.org

Job # 13926



2150 Smithtown Ave., Suite 3, Ronkonkoma, NY 11779
T: 631.580.3191 • F: 631.580.3195 • W: envirohealth.org

January 26, 2017

To: Greenport Union Free School District

Attached please find the results and remediation response of sampling performed in compliance with the United States Environmental Protection Agency's "3T's for Reducing Lead in Drinking Water in Schools", October, 2006 and New York State Department of Health Subpart 67-4 of Title 10, September 2016.

Sincerely,

A handwritten signature in black ink, appearing to read "Glenn Neuschwender", is written over a light gray rectangular background.

Glenn Neuschwender
President

DESIGN • INSPECTION • TESTING • ANALYSIS

TABLE OF CONTENTS

Appendix A - Greenport Schools

Appendix B - Lab Certifications

Appendix A
Greenport Schools

Lead in Drinking Water Test Results

As of 1/26/17

Sample Location	Fixture Type	1 st Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Remedial Recommendation	Remedial Response	Post Remediation Test Results
3rd Fl Girl's Gang BR	SK	4.08	-	-	None	-	-
3rd Fl Girl's BR (Hands)	SK	16.3	<1.0	<1.0	FR	Completed FR	162 (Sept. 2, 2016) <1.0 (Sept. 9, 2016)
3rd Fl Hall by RM 306 (Right)	WF	ND	-	-	None	-	-
3rd Fl ADA BR	SK	3.58	-	-	None	-	-
3rd Fl Hall by Rm 315 (Right)	WF	ND	-	-	None	-	-
3rd Fl Boy's Gang BR	SK	7.46	-	-	None	-	-
2nd Fl Hall by RM 218 (Right)	WF	ND	-	-	None	-	-
2nd Fl Boy's Gang BR	SK	13.2	-	-	None	-	-
Room 214	SK	11.6	-	-	None	-	-
Faculty BR Men	SK	5.92	-	-	None	-	-
Faculty BR Women	SK	6.1	-	-	None	-	-
2nd Fl Hall by RM 206 (Right)	WF	ND	-	-	None	-	-
2nd Fl Girl's Gang BR (Door)	SK	2.62	-	-	None	-	-
2nd Fl Girl's Gang BR (Left)	SK	16.3	<1.0	<1.0	FR	Completed FR	17 (Sept. 2, 2016) <1.0 (Sept. 9, 2016)
2nd Fl Girl's Gand BR (Right)	SK	11.9	-	-	None	-	-
Hall by RM 105 (Right)	WF	ND	-	-	None	-	-
1st Fl Girl's Gang BR (Door)	SK	26.6	2	1.1	FR	CAP	-
1st Fl Girl's Gang BR (Left)	SK	7.06	-	-	None	-	-
1st Fl Girl's Gang BR (Right)	SK	2.01	-	-	None	-	-
Btw RM 105 & 106 Boy's BR	SK	2.3	-	-	None	-	-
Btw RM 105 & 106 Girl's BR	SK	2.76	-	-	None	-	-

Lead in Drinking Water Test Results

As of 1/26/17

Sample Location	Fixture Type	1 st Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Remedial Recommendation	Remedial Response	Post Remediation Test Results
Main Office BR	SK	2.23	-	-	None	-	-
Hall by RM 112 (Right)	WF	ND	-	-	None	-	-
1st Fl Boy's Gang BR	SK	9.83	-	-	None	-	-
Art RM 114	SS	7.26	-	-	None	-	-
Art RM 115 (Left)	SK	3.87	-	-	None	-	-
Gym Men's BR (Right)	SK	9.75	-	-	None	-	-
Gym Men's BR (Middle)	SK	25.8	2.1	1.2	FR	Completed FR	#8.2 (Sept. 2, 2016)
Gym Women's BR (Left)	SK	118	9.2	7.9	FR	Completed FR	2120 (Sept. 2, 2016) #1.0 (Sept. 9, 2016)
Gym Women's BR (Middle)	SK	30.6	6.5	4.5	FR	Completed FR	337 (Sept. 2, 2016) <1.0 (Sept. 9, 2016)
Hall by RM 150	WF	80.8	7.1	2.6	FR	CAP	-
RM 150 Auto Shop (Middle)	SS	9.62	-	-	None	-	-
RM 151 Tech RM (Middle)	SS	13.2	-	-	None	-	-
Big Gym Boy's Side	WF	ND	-	-	None	-	-
RM 152C Boy's Coaches Office BR	SK	8.34	-	-	None	-	-
Big Gym Boy's LR	WF	25	24	6.9	FRSLV	CAP	-
Big Gym Boy's LR (Right)	SK	11.8	-	-	None	-	-
Hose Bib Near Gym Storage	SP	36.7	<1.0	<1.0	FR	Completed FRSLV	#3 (Sept. 2, 2016)
RM 109 Superintendent Office BR	SK	13.6	-	-	None	-	-
Boy's Coaches RM Ice Mach	SP	94.2	1.8	1.3	FR	Completed FRSLV	<1.0 (Sept. 2, 2016)
Big Gym Girl's Side	WF	ND	-	-	None	-	-
Girl's Coaches Office BR	SK	46.8	2.7	<1.0	FR	Completed FR	51 (Sept. 2, 2016) <1.0 (Sept. 9, 2016)

Action Level = 15.0 parts per billion (ppb) (ug/L)

Lead in Drinking Water Test Results

As of 1/26/17

Sample Location	Fixture Type	1 st Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Remedial Recommendation	Remedial Response	Post Remediation Test Results
Big Gym Girl's LR	WF	87.4	44	8.8	FRSLV	CAP	-
Big Gym Girl's LR BR (Left)	SK	19.2	2.7	4.7	FR	Completed FR	42 (Sept. 2, 2016) #1.8 (Sept. 9, 2016)
Hall by RM 157	WF	ND	-	-	None	-	-
RM 144	SK	6.93	-	-	None	-	-
RM 145	WF	255	53	13	FRSLV	CAP	-
RM 146	SK	21.4	17	2.1	FRSLV	Completed FR	28 (Sept. 2, 2016) <1.0 (Sept. 9, 2016)
RM 147	WF	90.3	3.2	1.5	FR	CAP	-
NE ADA Boy's BR	SK	32.9	35	12	FRSLV	Completed FR	22 (Sept. 2, 2016) <1.0 (Sept. 9, 2016)
Boy's BR by RM 156	SK	17.3	5.8	2.6	FR		
Girl's BR by RM 156	SK	2.05	-	-	None	-	-
RM 137 Aid's BR	SK	2.21	-	-	None	-	-
RM 144 Home Ec Station #1	SK	13.8	-	-	None	-	-
RM 144 Home Ec Station #2	SK	9.23	-	-	None	-	-
RM 144 Home Ec Station #3	SK	3.72	-	-	None	-	-
RM 144 Home Ec Station #4	SK	4.32	-	-	None	-	-
RM 144 Home Ec Station #5	SK	3.28	-	-	None	-	-
Small Gym	WF	ND	-	-	None	-	-
Kitchen 3 Piece	SK	4.69	-	-	None	-	-
Kitchen SK by Serving Line	SK	6.17	-	-	None	-	-
Kitchen SK Next to Fridge	SK	57.9	4.9	<1.0	FR	Completed FR	60 (Sept. 2, 2016) <1.0 (Sept. 9, 2016)

Lead in Drinking Water Test Results

As of 1/26/17

Sample Location	Fixture Type	1 st Draw Results (ppb)	15 Second Draw Results (ppb)	60 Second Draw Results (ppb)	Remedial Recommendation	Remedial Response	Post Remediation Test Results
RM 140 Aid's Break RM	SK	3.54	-	-	None	-	-
RM 101 Pre K	SK	8.1	-	-	None	-	-
RM 141 BR	SK	3.56	-	-	None	-	-
RM 102 Pre K	SS	1.7	-	-	None	-	-
Nurse Office	SK	10	<1.0	<1.0	None	-	-
Nurse Office BR	SK	2.9	1.9	1.4	None	-	-
Kitchen Handwashing	SK	6.9	<1.0	<1.0	None	-	-

Code Key

Remediation Type Codes

FR	=	Fixture replacement
FRSLV	=	Replacement of fixture, supply lines, and valves
FRSLVPA	=	Replacement of fixture, supply lines, valves and plumbing assessment
SIGN	=	Warning sign posting
CAP	=	Remove fixture or cap line

Room ID Codes

CC	=	Custodian Closet
MPR	=	Multi Purpose Room
Café	=	Cafeteria
Sci	=	Science Lab
PE	=	Physical Ed
BR	=	Bathroom
LR	=	Locker Room
RM	=	Room

Fixture Type Codes

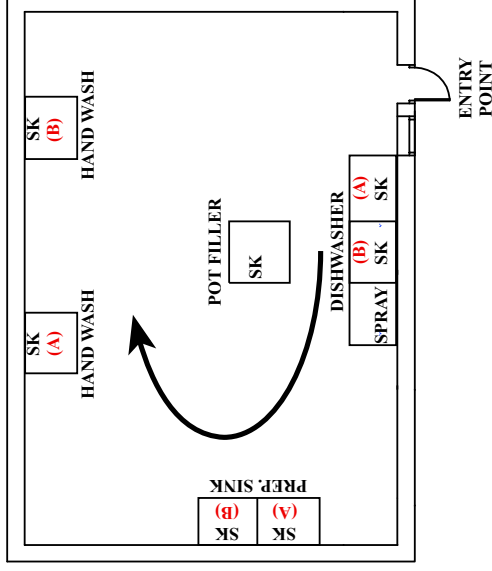
WF	=	Water Fountain
SK	=	Sink
SS	=	Slop Sink
SP	=	Spigot
PF	=	Pot Filler
HB	=	Hose Bib
IM	=	Ice Machine
WC	=	Water Cooler
SH	=	Shower

Result Code

ND	=	Not Detected
<	=	Less Than
-	=	No Testing Required




**KITCHEN
DIAGRAM**



SAMPLE IDENTIFICATION (example)

LOCATION	SOURCE
Kitchen Dishwash Station @ (A)	SK
Kitchen Dishwash Station @ (B)	SK
Kitchen Dishwasher	SPRAY
Prep. Sink @ (A)	SK
Prep. Sink @ (B)	SK
Kitchen Hand Wash @ (A)	SK
Kitchen Hand Wash @ (B)	SK
Kitchen Pot Filler	SK

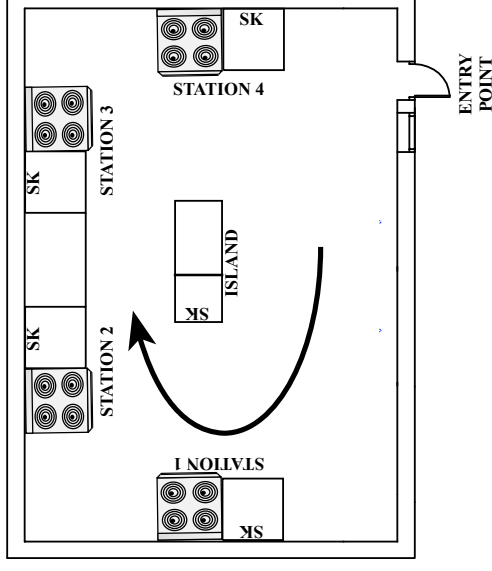
**HOME ECONOMICS / CAREER
DIAGRAM**



SAMPLE IDENTIFICATION (example)

LOCATION	SOURCE
Carrier RM - Station 1	SK
Carrier RM - Station 2	SK
Carrier RM - Station 3	SK
Carrier RM - Station 4	SK
Carrier RM - Island	SK

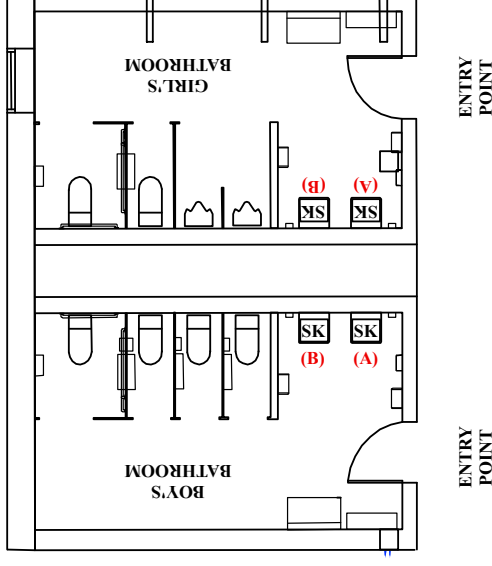
**GANG BATHROOM
DIAGRAM**




SAMPLE IDENTIFICATION (example)

LOCATION	SOURCE
Girls BR @ (A)	SK
Girls BR @ (B)	SK
Boy's BR @ (A)	SK
Boy's BR @ (B)	SK

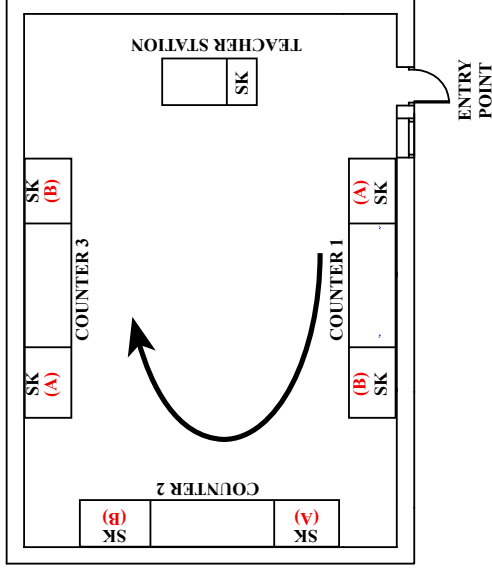
SCIENCE ROOM TYPE 1
DIAGRAM



SCIENCE ROOM TYPE 2
DIAGRAM

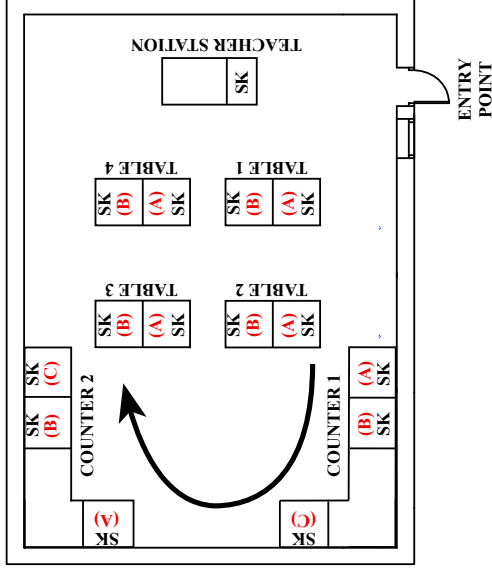

SCIENCE ROOM TYPE 3
DIAGRAM

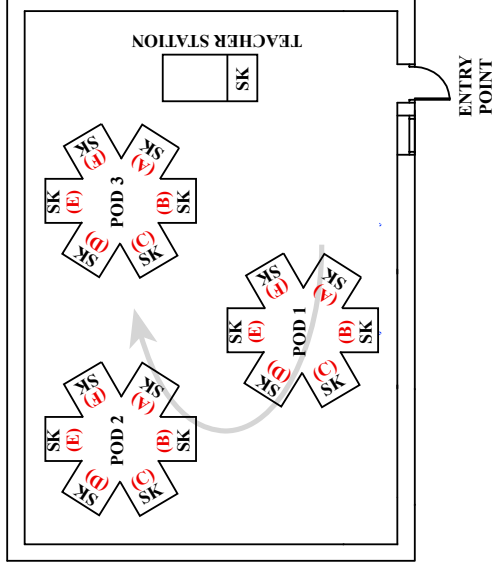

SAMPLE IDENTIFICATION (example)

LOCATION	SOURCE
Room 200 - Teacher Station	SK
Room 200 - Counter 1 @ (A)	SK
Room 200 - Counter 1 @ (B)	SK
Room 200 - Counter 2 @ (A)	SK
Room 200 - Counter 2 @ (B)	SK
Room 200 - Counter 3 @ (A)	SK
Room 200 - Counter 3 @ (B)	SK


SAMPLE IDENTIFICATION (example)

LOCATION	SOURCE
Room 200 - Teacher Station	SK
Room 200 - Table 1 @ (A)	SK
Room 200 - Table 1 @ (B)	SK
Room 200 - Table 2 @ (A)	SK
Room 200 - Table 2 @ (B)	SK
Room 200 - Table 3 @ (A)	SK
Room 200 - Table 3 @ (B)	SK
Room 200 - Table 4 @ (A)	SK
Room 200 - Table 4 @ (B)	SK
Room 200 - Counter 1 @ (A)	SK
Room 200 - Counter 1 @ (B)	SK
Room 200 - Counter 2 @ (C)	SK
Room 200 - Counter 2 @ (A)	SK
Room 200 - Counter 2 @ (B)	SK
Room 200 - Counter 2 @ (C)	SK

SAMPLE IDENTIFICATION (example)

LOCATION	SOURCE
Room 200 - Teacher Station	SK
Room 200 - POD 1 @ (A)	SK
Room 200 - POD 1 @ (B)	SK
Room 200 - POD 1 @ (C)	SK
Room 200 - POD 1 @ (D)	SK
Room 200 - POD 1 @ (E)	SK
Room 200 - POD 1 @ (F)	SK
Room 200 - POD 2 @ (A)	SK
Room 200 - POD 2 @ (B)	SK
Room 200 - POD 2 @ (C)	SK
Room 200 - POD 2 @ (D)	SK
Room 200 - POD 2 @ (E)	SK
Room 200 - POD 2 @ (F)	SK
Room 200 - POD 3 @ (A)	SK
Room 200 - POD 3 @ (B)	SK
Room 200 - POD 3 @ (C)	SK
Room 200 - POD 3 @ (D)	SK
Room 200 - POD 3 @ (E)	SK
Room 200 - POD 3 @ (F)	SK

First Draw Results



Technical Report

prepared for:

Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma NY, 11779
Attention: John V. Driscoll

Report Date: 07/08/2016
Client Project ID: Greenport UFSD
York Project (SDG) No.: 16F1200

CT Cert. No. PH-0723

New Jersey Cert. No. CT-005



New York Cert. No. 10854

PA Cert. No. 68-04440

Report Date: 07/08/2016
Client Project ID: Greenport UFSD
York Project (SDG) No.: 16F1200

Enviroscience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma NY, 11779
Attention: John V. Driscoll

Purpose and Results

This report contains the analytical data for the sample(s) identified on the attached chain-of-custody received in our laboratory on June 30, 2016 and listed below. The project was identified as your project: **Greenport UFSD**.

The analyses were conducted utilizing appropriate EPA, Standard Methods, and ASTM methods as detailed in the data summary tables.

All samples were received in proper condition meeting the customary acceptance requirements for environmental samples except those indicated under the Notes section of this report.

All analyses met the method and laboratory standard operating procedure requirements except as indicated by any data flags, the meaning of which are explained in the attachment to this report, and case narrative if applicable.

The results of the analyses, which are all reported on dry weight basis (soils) unless otherwise noted, are detailed in the following pages.

Please contact Client Services at 203.325.1371 with any questions regarding this report.

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
16F1200-01	3rd Fl Girl's Gang BR-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-02	3rd Fl Girl's BR (Hands)-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-03	3rd Fl Hall by RM 306 (right)-WF	Drinking Water	06/29/2016	06/30/2016
16F1200-04	3rd Fl ADA BR-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-05	3rd Fl Hall by RM 315 (right)-WF	Drinking Water	06/29/2016	06/30/2016
16F1200-06	3rd Fl Boy's Gang BR-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-07	2nd Fl Hall by RM 218 (right)-WF	Drinking Water	06/29/2016	06/30/2016
16F1200-08	2nd Fl Boy's Gang BR-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-09	Room 214-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-10	Faculty BR Men-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-11	Faculty BR Women-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-12	2nd Fl Hall by RM 206 (Right)-WF	Drinking Water	06/29/2016	06/30/2016
16F1200-13	2nd Fl Girl's Gang BR (Door)-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-14	2nd Fl Girl's Gang BR (left)-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-15	2nd Fl Girl's Gang BR (Right)-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-16	Hall by RM 105 (Right)-WF	Drinking Water	06/29/2016	06/30/2016
16F1200-17	1st Fl Girl's Gang BR (Door)-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-18	1st Fl Girl's Gang BR (Left)-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-19	1st Fl Girl's Gang BR (Right)-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-20	Btw RM 105 & 106 Boy's BR-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-21	Btw RM 105 & 106 Girl's BR-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-22	Main Office BR-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-23	Hall by RM 112 (right)-WF	Drinking Water	06/29/2016	06/30/2016

<u>York Sample ID</u>	<u>Client Sample ID</u>	<u>Matrix</u>	<u>Date Collected</u>	<u>Date Received</u>
16F1200-24	1st Fl boy's Gang BR-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-25	Art RM 114-SS	Drinking Water	06/29/2016	06/30/2016
16F1200-26	Art RM 115 (Left)-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-27	Gym Mens BR (Right)-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-28	Gym Mens BR (Middle)-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-29	Gym Womens BR (Left)-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-30	Gym Womens BR (Middle)-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-31	Hall by RM 150-WF	Drinking Water	06/29/2016	06/30/2016
16F1200-32	RM 150 Auto Shop (Middle)-SS	Drinking Water	06/29/2016	06/30/2016
16F1200-33	RM 151 Tech RM (Middle)-SS	Drinking Water	06/29/2016	06/30/2016
16F1200-34	Big Gym Boys side-WF	Drinking Water	06/29/2016	06/30/2016
16F1200-35	RM 152C Boy's Coaches Office BR-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-36	Big Gym Boys LR-WF	Drinking Water	06/29/2016	06/30/2016
16F1200-37	Big Gym Boys LR (Right)-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-38	Hose Bib near Gym Storage-SP	Drinking Water	06/29/2016	06/30/2016
16F1200-39	RM 109 Superintendent Office BR-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-40	Boy's Coaches RM Ice Mach-SP	Drinking Water	06/29/2016	06/30/2016
16F1200-41	Big Gym Girls side-WF	Drinking Water	06/29/2016	06/30/2016
16F1200-42	Girls Coaches Office BR-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-43	Big Gym Girls LR-WF	Drinking Water	06/29/2016	06/30/2016
16F1200-44	Big Gym Girls LR BR (left)-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-45	Hall by RM 157-WF	Drinking Water	06/29/2016	06/30/2016
16F1200-46	RM 144-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-47	RM 145-WF	Drinking Water	06/29/2016	06/30/2016
16F1200-48	RM 146-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-49	RM 147-WF	Drinking Water	06/29/2016	06/30/2016
16F1200-50	NE ADA Boys BR-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-51	Boys BR by RM 156-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-52	Girls BR by RM 156-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-53	RM 137 Aids BR-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-54	RM 144 Home Ec Station #1-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-55	RM 144 Home Ec Station #2-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-56	RM 144 Home Ec Station #3-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-57	RM 144 Home Ec Station #4-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-58	RM 144 Home Ec Station #5-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-59	Small Gym-WF	Drinking Water	06/29/2016	06/30/2016
16F1200-60	Kitchen 3 piece-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-61	Kitchen SK by Serving Line-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-62	Kitchen SK next to fridge-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-63	RM 140 Aids Break RM-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-64	RM 101 Pre K-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-65	RM 141 BR-SK	Drinking Water	06/29/2016	06/30/2016
16F1200-66	RM 102 Pre K-SS	Drinking Water	06/29/2016	06/30/2016

General Notes for York Project (SDG) No.: 16F1200

1. The RLs and MDLs (Reporting Limit and Method Detection Limit respectively) reported are adjusted for any dilution necessary due to the levels of target and/or non-target analytes and matrix interference. The RL(REPORTING LIMIT) is based upon the lowest standard utilized for the calibration where applicable.
2. Samples are retained for a period of thirty days after submittal of report, unless other arrangements are made.
3. York's liability for the above data is limited to the dollar value paid to York for the referenced project.
4. This report shall not be reproduced without the written approval of York Analytical Laboratories, Inc.
5. All samples were received in proper condition for analysis with proper documentation, unless otherwise noted.
6. All analyses conducted met method or Laboratory SOP requirements. See the Qualifiers and/or Narrative sections for further information.
7. It is noted that no analyses reported herein were subcontracted to another laboratory, unless noted in the report.
8. This report reflects results that relate only to the samples submitted on the attached chain-of-custody form(s) received by York.

Approved By:



Benjamin Gulizia
Laboratory Director

Date: 07/08/2016





Sample Information

Client Sample ID: 3rd Fl Girl's Gang BR-SK

York Sample ID: 16F1200-01

<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 12:47 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	4.08		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:50	07/06/2016 23:04	ALD

Sample Information

Client Sample ID: 3rd Fl Girl's BR (Hands)-SK

York Sample ID: 16F1200-02

<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 12:48 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	16.3		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:50	07/06/2016 23:10	ALD

Sample Information

Client Sample ID: 3rd Fl Hall by RM 306 (right)-WF

York Sample ID: 16F1200-03

<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 12:49 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:50	07/06/2016 23:17	ALD

Sample Information

Client Sample ID: 3rd Fl ADA BR-SK

York Sample ID: 16F1200-04

<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 12:50 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:



Sample Information

Client Sample ID: 3rd FI ADA BR-SK **York Sample ID:** 16F1200-04

York Project (SDG) No. 16F1200 **Client Project ID** Greenport UFSD **Matrix** Drinking Water **Collection Date/Time** June 29, 2016 12:50 pm **Date Received** 06/30/2016

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	3.58		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:50	07/06/2016 23:24	ALD

Sample Information

Client Sample ID: 3rd FI Hall by RM 315 (right)-WF **York Sample ID:** 16F1200-05

York Project (SDG) No. 16F1200 **Client Project ID** Greenport UFSD **Matrix** Drinking Water **Collection Date/Time** June 29, 2016 12:51 pm **Date Received** 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:50	07/06/2016 23:31	ALD

Sample Information

Client Sample ID: 3rd FI Boy's Gang BR-SK **York Sample ID:** 16F1200-06

York Project (SDG) No. 16F1200 **Client Project ID** Greenport UFSD **Matrix** Drinking Water **Collection Date/Time** June 29, 2016 12:52 pm **Date Received** 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	7.46		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:50	07/06/2016 23:51	ALD

Sample Information

Client Sample ID: 2nd FI Hall by RM 218 (right)-WF **York Sample ID:** 16F1200-07

York Project (SDG) No. 16F1200 **Client Project ID** Greenport UFSD **Matrix** Drinking Water **Collection Date/Time** June 29, 2016 12:54 pm **Date Received** 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
---------	-----------	--------	------	-------	---------	--------------------	----------	------------------	-----------------------	-----------------------	---------



Sample Information

Client Sample ID: 2nd Fl Hall by RM 218 (right)-WF **York Sample ID:** 16F1200-07

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 12:54 pm 06/30/2016

Lead by EPA 200.8

Sample Prepared by Method: EPA 200.8

Log-in Notes:

Sample Notes:

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:50	07/06/2016 23:58	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: 2nd Fl Boy's Gang BR-SK **York Sample ID:** 16F1200-08

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 12:55 pm 06/30/2016

Lead by EPA 200.8

Sample Prepared by Method: EPA 200.8

Log-in Notes:

Sample Notes:

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	13.2		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:50	07/07/2016 00:05	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: Room 214-SK **York Sample ID:** 16F1200-09

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 12:56 pm 06/30/2016

Lead by EPA 200.8

Sample Prepared by Method: EPA 200.8

Log-in Notes:

Sample Notes:

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	11.6		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:50	07/07/2016 00:12	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: Faculty BR Men-SK **York Sample ID:** 16F1200-10

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 12:57 pm 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:



Sample Information

Client Sample ID: Faculty BR Men-SK

York Sample ID: 16F1200-10

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 12:57 pm	06/30/2016

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	5.92		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:50	07/07/2016 00:19	ALD

Sample Information

Client Sample ID: Faculty BR Women-SK

York Sample ID: 16F1200-11

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 12:58 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	6.10		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:50	07/07/2016 00:25	ALD

Sample Information

Client Sample ID: 2nd Fl Hall by RM 206 (Right)-WF

York Sample ID: 16F1200-12

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 12:59 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:50	07/07/2016 00:32	ALD

Sample Information

Client Sample ID: 2nd Fl Girl's Gang BR (Door)-SK

York Sample ID: 16F1200-13

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:00 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
---------	-----------	--------	------	-------	---------	--------------------	----------	------------------	-----------------------	-----------------------	---------



Sample Information

Client Sample ID: 2nd Fl Girl's Gang BR (Door)-SK **York Sample ID:** 16F1200-13

York Project (SDG) No. 16F1200 **Client Project ID** Greenport UFSD **Matrix** Drinking Water **Collection Date/Time** June 29, 2016 1:00 pm **Date Received** 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	2.62		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:50	07/07/2016 00:39	ALD

Sample Information

Client Sample ID: 2nd Fl Girl's Gang BR (left)-SK **York Sample ID:** 16F1200-14

York Project (SDG) No. 16F1200 **Client Project ID** Greenport UFSD **Matrix** Drinking Water **Collection Date/Time** June 29, 2016 1:01 pm **Date Received** 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	16.3		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:50	07/07/2016 00:46	ALD

Sample Information

Client Sample ID: 2nd Fl Girl's Gang BR (Right)-SK **York Sample ID:** 16F1200-15

York Project (SDG) No. 16F1200 **Client Project ID** Greenport UFSD **Matrix** Drinking Water **Collection Date/Time** June 29, 2016 1:02 pm **Date Received** 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	11.9		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:51	07/07/2016 01:27	ALD

Sample Information

Client Sample ID: Hall by RM 105 (Right)-WF **York Sample ID:** 16F1200-16

York Project (SDG) No. 16F1200 **Client Project ID** Greenport UFSD **Matrix** Drinking Water **Collection Date/Time** June 29, 2016 1:04 pm **Date Received** 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
---------	-----------	--------	------	-------	---------	--------------------	----------	------------------	-----------------------	-----------------------	---------

120 RESEARCH DRIVE

STRATFORD, CT 06615

(203) 325-1371

FAX (203) 357-0166



Sample Information

Client Sample ID: Hall by RM 105 (Right)-WF

York Sample ID: 16F1200-16

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:04 pm	06/30/2016

7439-92-1	Lead	ND	ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:51	07/07/2016 01:47	ALD
							Certifications:	CTDOH,NELAC-NY10854,NJDEP,PADEP		

Sample Information

Client Sample ID: 1st Fl Girl's Gang BR (Door)-SK

York Sample ID: 16F1200-17

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:05 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	26.6		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:51	07/07/2016 01:54	ALD
							Certifications:	CTDOH,NELAC-NY10854,NJDEP,PADEP			

Sample Information

Client Sample ID: 1st Fl Girl's Gang BR (Left)-SK

York Sample ID: 16F1200-18

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:06 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	7.06		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:51	07/07/2016 02:01	ALD
							Certifications:	CTDOH,NELAC-NY10854,NJDEP,PADEP			

Sample Information

Client Sample ID: 1st Fl Girl's Gang BR (Right)-SK

York Sample ID: 16F1200-19

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:07 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	2.01		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:51	07/07/2016 02:07	ALD
							Certifications:	CTDOH,NELAC-NY10854,NJDEP,PADEP			



Sample Information

Client Sample ID: Btw RM 105 & 106 Boy's BR-SK **York Sample ID:** 16F1200-20

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:08 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	2.30		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:51	07/07/2016 02:14	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: Btw RM 105 & 106 Girl's BR-SK **York Sample ID:** 16F1200-21

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:09 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	2.76		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:51	07/07/2016 02:35	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: Main Office BR-SK **York Sample ID:** 16F1200-22

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:10 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	2.23		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:51	07/07/2016 02:41	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: Hall by RM 112 (right)-WF **York Sample ID:** 16F1200-23

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:12 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
120 RESEARCH DRIVE STRATFORD, CT 06615 (203) 325-1371 FAX (203) 357-0166											



Sample Information

Client Sample ID: Hall by RM 112 (right)-WF

York Sample ID: 16F1200-23

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:12 pm	06/30/2016

7439-92-1	Lead	ND	ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:51	07/07/2016 02:48	ALD
							Certifications:	CTDOH,NELAC-NY10854,NJDEP,PADEP		

Sample Information

Client Sample ID: 1st Fl boy's Gang BR-SK

York Sample ID: 16F1200-24

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:13 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	9.83		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:51	07/07/2016 02:55	ALD
								Certifications:	CTDOH,NELAC-NY10854,NJDEP,PADEP		

Sample Information

Client Sample ID: Art RM 114-SS

York Sample ID: 16F1200-25

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:14 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	7.26		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:51	07/07/2016 03:02	ALD
								Certifications:	CTDOH,NELAC-NY10854,NJDEP,PADEP		

Sample Information

Client Sample ID: Art RM 115 (Left)-SK

York Sample ID: 16F1200-26

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:15 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	3.87		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:51	07/07/2016 03:09	ALD
								Certifications:	CTDOH,NELAC-NY10854,NJDEP,PADEP		



Sample Information

Client Sample ID: Gym Mens BR (Right)-SK

York Sample ID: 16F1200-27

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:17 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	9.75		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:51	07/07/2016 03:16	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: Gym Mens BR (Middle)-SK

York Sample ID: 16F1200-28

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:18 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	25.8		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:51	07/07/2016 03:22	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: Gym Womens BR (Left)-SK

York Sample ID: 16F1200-29

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:19 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	118		ug/L	0.650	10.0	10	EPA 200.8	07/06/2016 08:51	07/07/2016 19:25	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: Gym Womens BR (Middle)-SK

York Sample ID: 16F1200-30

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:20 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
---------	-----------	--------	------	-------	---------	--------------------	----------	------------------	-----------------------	-----------------------	---------

120 RESEARCH DRIVE

STRATFORD, CT 06615

(203) 325-1371

FAX (203) 357-0166



Sample Information

<u>Client Sample ID:</u> Gym Womens BR (Middle)-SK										<u>York Sample ID:</u> 16F1200-30													
<u>York Project (SDG) No.</u> 16F1200					<u>Client Project ID</u> Greenport UFSD					<u>Matrix</u> Drinking Water		<u>Collection Date/Time</u> June 29, 2016 1:20 pm		<u>Date Received</u> 06/30/2016									
7439-92-1		Lead		30.6		ug/L		0.065		1.00		1		EPA 200.8		07/06/2016 08:51		07/07/2016 03:36		ALD			
														Certifications:		CTDOH,NELAC-NY10854,NJDEP,PADEP							

Sample Information

<u>Client Sample ID:</u> Hall by RM 150-WF			<u>York Sample ID:</u> 16F1200-31	
<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:21 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	80.8		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:51	07/07/2016 03:56	ALD

Sample Information

<u>Client Sample ID:</u> RM 150 Auto Shop (Middle)-SS			<u>York Sample ID:</u> 16F1200-32	
<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:22 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	9.62		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:51	07/07/2016 04:03	ALD

Sample Information

<u>Client Sample ID:</u> RM 151 Tech RM (Middle)-SS			<u>York Sample ID:</u> 16F1200-33	
<u>York Project (SDG) No.</u> 16F1200	<u>Client Project ID</u> Greenport UFSD	<u>Matrix</u> Drinking Water	<u>Collection Date/Time</u> June 29, 2016 1:23 pm	<u>Date Received</u> 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	13.2		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:51	07/07/2016 04:10	ALD



Sample Information

Client Sample ID: Big Gym Boys side-WF

York Sample ID: 16F1200-34

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:24 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:51	07/07/2016 04:17	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: RM 152C Boy's Coaches Office BR-SK

York Sample ID: 16F1200-35

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:25 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	8.34		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:52	07/07/2016 04:44	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: Big Gym Boys LR-WF

York Sample ID: 16F1200-36

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:26 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	25.0		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:52	07/07/2016 05:18	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: Big Gym Boys LR (Right)-SK

York Sample ID: 16F1200-37

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:28 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:



Sample Information

Client Sample ID: Big Gym Boys LR (Right)-SK **York Sample ID:** 16F1200-37

York Project (SDG) No. 16F1200 **Client Project ID** Greenport UFSD **Matrix** Drinking Water **Collection Date/Time** June 29, 2016 1:28 pm **Date Received** 06/30/2016

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	11.8		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 05:25	ALD

Sample Information

Client Sample ID: Hose Bib near Gym Storage-SP **York Sample ID:** 16F1200-38

York Project (SDG) No. 16F1200 **Client Project ID** Greenport UFSD **Matrix** Drinking Water **Collection Date/Time** June 29, 2016 1:29 pm **Date Received** 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	36.7		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 05:32	ALD

Sample Information

Client Sample ID: RM 109 Superintendent Office BR-SK **York Sample ID:** 16F1200-39

York Project (SDG) No. 16F1200 **Client Project ID** Greenport UFSD **Matrix** Drinking Water **Collection Date/Time** June 29, 2016 1:30 pm **Date Received** 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	13.6		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 05:39	ALD

Sample Information

Client Sample ID: Boy's Coaches RM Ice Mach-SP **York Sample ID:** 16F1200-40

York Project (SDG) No. 16F1200 **Client Project ID** Greenport UFSD **Matrix** Drinking Water **Collection Date/Time** June 29, 2016 1:35 pm **Date Received** 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	94.2		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 05:46	ALD



Sample Information

Client Sample ID: Boy's Coaches RM Ice Mach-SP **York Sample ID:** 16F1200-40

<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:35 pm	06/30/2016

Sample Information

Client Sample ID: Big Gym Girls side-WF **York Sample ID:** 16F1200-41

<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:36 pm	06/30/2016

Lead by EPA 200.8

Sample Prepared by Method: EPA 200.8

Log-in Notes:

Sample Notes:

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 05:52	ALD

Sample Information

Client Sample ID: Girls Coaches Office BR-SK **York Sample ID:** 16F1200-42

<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:37 pm	06/30/2016

Lead by EPA 200.8

Sample Prepared by Method: EPA 200.8

Log-in Notes:

Sample Notes:

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	46.8		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 05:59	ALD

Sample Information

Client Sample ID: Big Gym Girls LR-WF **York Sample ID:** 16F1200-43

<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:38 pm	06/30/2016

Lead by EPA 200.8

Sample Prepared by Method: EPA 200.8

Log-in Notes:

Sample Notes:

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	87.4		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 06:06	ALD



Sample Information

Client Sample ID: Big Gym Girls LR BR (left)-SK **York Sample ID:** 16F1200-44

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:39 pm	06/30/2016

Lead by EPA 200.8

Sample Prepared by Method: EPA 200.8

Log-in Notes:

Sample Notes:

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	19.2		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:52	07/07/2016 06:13	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: Hall by RM 157-WF **York Sample ID:** 16F1200-45

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:40 pm	06/30/2016

Lead by EPA 200.8

Sample Prepared by Method: EPA 200.8

Log-in Notes:

Sample Notes:

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:52	07/07/2016 06:20	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: RM 144-SK **York Sample ID:** 16F1200-46

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:41 pm	06/30/2016

Lead by EPA 200.8

Sample Prepared by Method: EPA 200.8

Log-in Notes:

Sample Notes:

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	6.93		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:52	07/07/2016 06:40	ALD
Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP											

Sample Information

Client Sample ID: RM 145-WF **York Sample ID:** 16F1200-47

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:42 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:



Sample Information

Client Sample ID: RM 145-WF

York Sample ID: 16F1200-47

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:42 pm	06/30/2016

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	255		ug/L	0.650	10.0	10	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 19:46	ALD

Sample Information

Client Sample ID: RM 146-SK

York Sample ID: 16F1200-48

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:43 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	21.4		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 06:54	ALD

Sample Information

Client Sample ID: RM 147-WF

York Sample ID: 16F1200-49

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:44 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	90.3		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 07:01	ALD

Sample Information

Client Sample ID: NE ADA Boys BR-SK

York Sample ID: 16F1200-50

York Project (SDG) No.	Client Project ID	Matrix	Collection Date/Time	Date Received
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:47 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	32.9		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 07:08	ALD



Sample Information

Client Sample ID: NE ADA Boys BR-SK **York Sample ID:** 16F1200-50

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 1:47 pm 06/30/2016

Sample Information

Client Sample ID: Boys BR by RM 156-SK **York Sample ID:** 16F1200-51

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 1:48 pm 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	17.3		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 07:14	ALD

Sample Information

Client Sample ID: Girls BR by RM 156-SK **York Sample ID:** 16F1200-52

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 1:49 pm 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	2.05		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 07:21	ALD

Sample Information

Client Sample ID: RM 137 Aids BR-SK **York Sample ID:** 16F1200-53

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 1:50 pm 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	2.21		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 07:28	ALD



Sample Information

Client Sample ID: RM 144 Home Ec Station #1-SK **York Sample ID:** 16F1200-54

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 1:51 pm 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	13.8		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:52	07/07/2016 07:35	ALD

Sample Information

Client Sample ID: RM 144 Home Ec Station #2-SK **York Sample ID:** 16F1200-55

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 1:52 pm 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	9.23		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:53	07/07/2016 08:16	ALD

Sample Information

Client Sample ID: RM 144 Home Ec Station #3-SK **York Sample ID:** 16F1200-56

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 1:53 pm 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	3.72		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:53	07/07/2016 08:36	ALD

Sample Information

Client Sample ID: RM 144 Home Ec Station #4-SK **York Sample ID:** 16F1200-57

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 1:54 pm 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
120 RESEARCH DRIVE STRATFORD, CT 06615 (203) 325-1371 FAX (203) 357-0166											



Sample Information

Client Sample ID: RM 144 Home Ec Station #4-SK

York Sample ID: 16F1200-57

<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:54 pm	06/30/2016

7439-92-1	Lead	4.32	ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:53	07/07/2016 08:43	ALD
							Certifications:	CTDOH,NELAC-NY10854,NJDEP,PADEP		

Sample Information

Client Sample ID: RM 144 Home Ec Station #5-SK

York Sample ID: 16F1200-58

<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:55 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	3.28		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:53	07/07/2016 08:50	ALD
							Certifications:	CTDOH,NELAC-NY10854,NJDEP,PADEP			

Sample Information

Client Sample ID: Small Gym-WF

York Sample ID: 16F1200-59

<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:56 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	ND		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:53	07/07/2016 08:57	ALD
							Certifications:	CTDOH,NELAC-NY10854,NJDEP,PADEP			

Sample Information

Client Sample ID: Kitchen 3 piece-SK

York Sample ID: 16F1200-60

<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 1:57 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	4.69		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:53	07/07/2016 09:04	ALD
							Certifications:	CTDOH,NELAC-NY10854,NJDEP,PADEP			



Sample Information

Client Sample ID: Kitchen SK by Serving Line-SK **York Sample ID:** 16F1200-61

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 1:58 pm 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	6.17		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:53	07/07/2016 09:24	ALD

Sample Information

Client Sample ID: Kitchen SK next to fridge-SK **York Sample ID:** 16F1200-62

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 2:00 pm 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	57.9		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:53	07/07/2016 09:31	ALD

Sample Information

Client Sample ID: RM 140 Aids Break RM-SK **York Sample ID:** 16F1200-63

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 2:02 pm 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	3.54		ug/L	0.065	1.00	1	EPA 200.8 Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP	07/06/2016 08:53	07/07/2016 09:38	ALD

Sample Information

Client Sample ID: RM 101 Pre K-SK **York Sample ID:** 16F1200-64

York Project (SDG) No. Client Project ID Matrix Collection Date/Time Date Received
16F1200 Greenport UFSD Drinking Water June 29, 2016 2:03 pm 06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
120 RESEARCH DRIVE	STRATFORD, CT 06615	(203) 325-1371	FAX (203) 357-0166								



Sample Information

Client Sample ID: RM 101 Pre K-SK										York Sample ID: 16F1200-64					
<u>York Project (SDG) No.</u>				<u>Client Project ID</u>				<u>Matrix</u>		<u>Collection Date/Time</u>		<u>Date Received</u>			
16F1200				Greenport UFSD				Drinking Water		June 29, 2016 2:03 pm		06/30/2016			
7439-92-1	Lead	8.10	ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:53	07/07/2016 09:45	ALD					
							Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP								

Sample Information

<u>Client Sample ID:</u> RM 141 BR-SK			<u>York Sample ID:</u> 16F1200-65	
<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 2:04 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	3.56		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:53	07/07/2016 09:52	ALD
		Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP									

Sample Information

<u>Client Sample ID:</u> RM 102 Pre K-SS			<u>York Sample ID:</u> 16F1200-66	
<u>York Project (SDG) No.</u>	<u>Client Project ID</u>	<u>Matrix</u>	<u>Collection Date/Time</u>	<u>Date Received</u>
16F1200	Greenport UFSD	Drinking Water	June 29, 2016 2:05 pm	06/30/2016

Lead by EPA 200.8

Log-in Notes:

Sample Notes:

Sample Prepared by Method: EPA 200.8

CAS No.	Parameter	Result	Flag	Units	LOD/MDL	Reported to LOQ	Dilution	Reference Method	Date/Time Prepared	Date/Time Analyzed	Analyst
7439-92-1	Lead	1.70		ug/L	0.065	1.00	1	EPA 200.8	07/06/2016 08:53	07/07/2016 09:58	ALD
		Certifications: CTDOH,NELAC-NY10854,NJDEP,PADEP									



Notes and Definitions

M-HCSpk Sample conc. >10 X spike conc.

*	Analyte is not certified or the state of the samples origination does not offer certification for the Analyte.
ND	NOT DETECTED - the analyte is not detected at the Reported to level (LOQ/RL or LOD/MDL)
RL	REPORTING LIMIT - the minimum reportable value based upon the lowest point in the analyte calibration curve.
LOQ	LIMIT OF QUANTITATION - the minimum concentration of a target analyte that can be reported within a specified degree of confidence. This is the lowest point in an analyte calibration curve that has been subjected to all steps of the processing/analysis and verified to meet defined criteria. This is based upon NELAC 2009 Standards and applies to all analyses.
LOD	LIMIT OF DETECTION - a verified estimate of the minimum concentration of a substance in a given matrix that an analytical process can reliably detect. This is based upon NELAC 2009 Standards and applies to all analyses conducted under the auspices of EPA SW-846.
MDL	METHOD DETECTION LIMIT - a statistically derived estimate of the minimum amount of a substance an analytical system can reliably detect with a 99% confidence that the concentration of the substance is greater than zero. This is based upon 40 CFR Part 136 Appendix B and applies only to EPA 600 and 200 series methods.
Reported to	This indicates that the data for a particular analysis is reported to either the LOD/MDL, or the LOQ/RL. In cases where the "Reported to" is located above the LOD/MDL, any value between this and the LOQ represents an estimated value which is "J" flagged accordingly. This applies to volatile and semi-volatile target compounds only.
NR	Not reported
RPD	Relative Percent Difference
Wet	The data has been reported on an as-received (wet weight) basis
Low Bias	Low Bias flag indicates that the recovery of the flagged analyte is below the laboratory or regulatory lower control limit. The data user should take note that this analyte may be biased low but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
High Bias	High Bias flag indicates that the recovery of the flagged analyte is above the laboratory or regulatory upper control limit. The data user should take note that this analyte may be biased high but should evaluate multiple lines of evidence including the LCS and site-specific MS/MSD data to draw bias conclusions. In cases where no site-specific MS/MSD was requested, only the LCS data can be used to evaluate such bias.
Non-Dir.	Non-dir. flag (Non-Directional Bias) indicates that the Relative Percent Difference (RPD) (a measure of precision) among the MS and MSD data is outside the laboratory or regulatory control limit. This alerts the data user where the MS and MSD are from site-specific samples that the RPD is high due to either non-homogeneous distribution of target analyte between the MS/MSD or indicates poor reproducibility for other reasons.

If EPA SW-846 method 8270 is included herein it is noted that the target compound N-nitrosodiphenylamine (NDPA) decomposes in the gas chromatographic inlet and cannot be separated from diphenylamine (DPA). These results could actually represent 100% DPA, 100% NDPA or some combination of the two. For this reason, York reports the combined result for n-nitrosodiphenylamine and diphenylamine for either of these compounds as a combined concentration as Diphenylamine.

If Total PCBs are detected and the target aroclors reported are "Not detected", the Total PCB value is reported due to the presence of either or both Aroclors 1262 and 1268 which are non-target aroclors for some regulatory lists.

2-chloroethylvinyl ether readily breaks down under acidic conditions. Samples that are acid preserved, including standards will exhibit breakdown. The data user should take note.

Certification for pH is no longer offered by NYDOH ELAP.

Semi-Volatile and Volatile analyses are reported down to the LOD/MDL, with values between the LOD/MDL and the LOQ being "J" flagged as estimated results.

For analyses by EPA SW-846-8270D, the Limit of Quantitation (LOQ) reported for benzidine is based upon the lowest standard used for calibration and is not a verified LOQ due to this compound's propensity for oxidative losses during extraction/concentration procedures and non-reproducible chromatographic performance.





YORK ANALYTICAL LABORATORIES
120 RESEARCH DR.
STRATFORD, CT 06615
(203) 325-1371
FAX (203) 357-0166

YORK
ANALYTICAL LABORATORIES INC.

Field Chain-of-Custody Record

Page 2 of 7

NOTE: York's Std. Terms & Conditions are listed on the back side of this document.
This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

York Project No. 16F1200

YOUR Information Company: <u>Environ Science</u> Address: <u>2110 Smithtown</u> <u>Pinkenkama, NY 11795</u> Phone No. <u>631 880 3151</u> Contact Person: <u>Thon Driscoll</u> E-Mail Address: <u>tdriscoll@environsci.org</u>		Report To: Company: _____ Address: _____ Phone No. <u>609 441 1234</u> Attention: _____ E-Mail Address: _____		Invoice To: Company: _____ Address: _____ Phone No. _____ Attention: <u>Judy Brunten</u> E-Mail Address: <u>tdriscoll@environsci.org</u>		YOUR Project ID <u>Greenport WFD</u> Purchase Order No. _____		Turn-Around Time RUSH - Same Day ☐ RUSH - Next Day ☐ RUSH - Two Day ☐ RUSH - Three Day ☐ RUSH - Four Day ☐ Standard (5-7 Days) ☒		Report Type Summary Report ☒ Summary w/ QA Summary ☐ CT RCP Package ☐ CTRCP DOA/DUE Pkg ☐ NY ASP A Package ☐ NY ASP B Package ☐ NJDEP Red. Deliv. ☐ Electronic Data Deliverables (EDD) ☐ Simple Excel ☐ NY SDEC EQuIS ☐ EQuIS (std) ☐ EZ-EDD (EQuIS) ☐ NJDEP SRP HazSite EDD ☐ GIS/KEY (std) ☐ Other ☐ York Regulatory Comparison ☐ Excel Spreadsheet ☐ Compare to the following Regs. (please fill in): _____	
---	--	---	--	--	--	--	--	--	--	--	--

Print Clearly and Legibly. All Information must be complete.
Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.

Samples Collected/Authorized By (Signature)
[Signature]
Name (printed)
Glen Borkost

Sample Identification	Date/Time Sampled	Sample Matrix	Choose Analyses Needed from the Menu Above and Enter Below										Container Description(s)
Faculty BR Women-SK 6/29/16 12:00	12:59	DW	total lead										(1) 200ml
2nd Fl Hall by RM 200 (Right)WF	13:00												
2nd Fl Girls Gang BR (back)-SK	13:01												
2nd Fl Girls Gang BR (left)-SK	13:02												
2nd Fl Girls Gang BR (Right)-SK	13:04												
Hall by RM 105 (Right)-WF	13:05												
1st Fl Girls Gang BR (back)-SK	13:06												
1st Fl Girls Gang BR (left)-SK	13:07												
1st Fl Girls Gang BR (Right)-SK	13:08												
2 RM 105 & 106 Boys BR-SK													
Comments	Preservation		4°C	Frozen	HCl	MeOH	HNO ₃	H ₂ SO ₄	NaOH	Temperature on Receipt			
	Check those Applicable										4.9 °C		
	Special Instructions												
Field Filtered		Samples Relinquished By		6/30/16		Date/Time		Samples Received By		Date/Time			
Lab to Filter		Samples Relinquished By		Date/Time		Samples Received in LAB by		Date/Time					

Page 27 of 32



YORK ANALYTICAL LABORATORIES
120 RESEARCH DR.
STRATFORD, CT 06615
(203) 325-1371
FAX (203) 357-0166

Field Chain-of-Custody Record

Page 3 of 7

NOTE: York's Std. Terms & Conditions are listed on the back side of this document.
This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

York Project No. 1061206

YOUR Information		Report To:		Invoice To:		YOUR Project ID		Turn-Around Time		Report Type			
Company: <u>Environance</u>	Company: _____	Company: _____		Company: _____		YOUR Project ID: <u>Greenport WFD</u>		Turn-Around Time: ☐ RUSH - Same Day ☐ RUSH - Next Day ☐ RUSH - Two Day ☐ RUSH - Three Day ☐ RUSH - Four Day		Report Type: ☒ Summary Report ☐ Summary w/ QA Summary ☐ CT RCP Package ☐ CTRCP DQA/DUE Pkg ☐ NY ASP A Package ☐ NY ASP B Package ☐ NJDEP Red. Deliv. ☐ Electronic Data Deliverables (EDD)			
Address: <u>2150 Smithtown Rd</u>	Address: _____	Address: _____		Address: _____		Purchase Order No. _____		Standard(5-7 Days) ☒					
Phone No. <u>631 580 3191</u>	Phone No. _____	Phone No. _____		Phone No. _____		Attention: <u>Judy Buenters</u>		Misc. Org. _____					
Contact Person: <u>Ther Driscoll</u>	Contact Person: _____	Contact Person: _____		Contact Person: _____		E-Mail: <u>thdriscoll@environance.com</u>		Misc. _____					
E-Mail: <u>thdriscoll@environance.com</u>		E-Mail: _____		E-Mail: _____		E-Mail: _____		Misc. _____					
Print Clearly and Legibly. All Information must be complete. Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.		Matrix Codes S - soil Other - specify (oil, etc.) WW - wastewater GW - groundwater DW - drinking water Air-A - ambient air Air-SV - soil vapor		Volatiles 8260 full 624 STARS list BTEX MTBE TCL list TAGM list CT RCP list Arom. only Halog. only App. IX list 8021B list		Semi-Volatiles 8270 or 625 STARS list BN Only Acids Only PAH list App. IX TAGM list CT RCP list TCL list NIDEF list App. IX TCLP BNA SPLP/TCLP		Metals RCRA8 PP13 list TAL CT15 list TAGM list NIDEF list Total Dissolved SPLP/TCLP Indic. Metals LIST Below 608 PCB		Full Lists Pri. Poll. TCL Ognix TAL MacCN Full TCLP Full App. IX Part 360/400 Part 360/400/401 Part 360/400/402 NYCDEP Newer NYSDDEC TAGM Silica		Misc. _____	
Samples Collected/Authorized By (Signature) <u>[Signature]</u>		Name (printed) <u>Glen Kornblith</u>		Choose Analyses Needed from the Menu Above and Enter Below		Container Description(s) <u>(1) 250ml</u>							
Sample Identification	Date/Time Sampled	Sample Matrix	Preservation	Check those Applicable Special Instructions Field Filtered ☐ Lab to Filter ☐	4°C _____ Frozen _____ HCl _____ ZnAc _____ MeOH _____ HNO ₃ _____ H ₂ SO ₄ _____ NaOH _____ Other _____	Temperature on Receipt <u>250 pm</u>							
Btw RH 1008 106 birtle BR-SK	13:09	DW	↓										
Main Office BR-SK	13:10												
Hall by RH112 (right) -WF	13:12												
1st Fl Boys Garry BR-SK	13:13												
Art RH 114-SS	13:14												
Art RH 115 (Left) -SK	13:15												
Gym Mens BR (Right) -SK	13:17												
Gym Mens BR (Middle) -SK	13:18												
Gym Womens BR (Left) -SK	13:19												
Gym Womens BR (Middle) -SK	13:20												
Comments					Samples Relinquished By <u>[Signature]</u> Date/Time <u>6/1/16</u> Samples Received By <u>[Signature]</u> Date/Time <u>6/30/16-1750</u> Date/Time <u>4.9 °C</u>								



YORK ANALYTICAL LABORATORIES
120 RESEARCH DR.
STRATFORD, CT 06615
(203) 325-1371
FAX (203) 357-0166

Field Chain-of-Custody Record

Page 4 of 7

NOTE: York's Std. Terms & Conditions are listed on the back side of this document.
This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

York Project No. 16F1200

YOUR Information		Report To:		Invoice To:		YOUR Project ID		Turn-Around Time		Report Type			
Company: <u>Environex</u>		Company: _____		Company: _____		<u>Greenport WFD</u>		☐ RUSH - Same Day ☐ RUSH - Next Day ☐ RUSH - Two Day ☐ RUSH - Three Day ☐ RUSH - Four Day		☒ Standard (5-7 Days)		☒ Summary Report ☐ Summary w/ QA Summary ☐ CT RCP Package ☐ CT RCP DQA/DUE Pkg ☐ NY ASP A Package ☐ NY ASP B Package ☐ NJDEP Red. Deliv. ☐ Electronic Data Deliverables (EDD)	
Address: <u>2150 Summittown Dr.</u>		Address: _____		Address: _____		<u>Greenport WFD</u>		☐ Full Poll. ☐ TCL Oganics ☐ TAL MetCN ☐ Full TCLP ☐ Full App. IX ☐ Part 360 Routine ☐ Part 360 Residue ☐ Part 360 (Residue) Not Below 1000 ☐ NYDEP Sewer ☐ NYDEP Censor ☐ NYDEP Censor Asbestos ☐ TAGM ☐ Silica		☐ Simple Excel ☐ NYSDEC EQULS ☐ EQULS (std) ☐ EZ-EDD (EQULS) ☐ NJDEP SRP HazSite EDD ☐ GIS/KEY (std) ☐ Other ☐ York Regulatory Comparison ☐ Excel Spreadsheet ☐ Compare to the following flags. (please fill in):			
Phone No. <u>631-580 3191</u>		Phone No. _____		Phone No. _____		<u>Greenport WFD</u>		☐ Full Poll. ☐ TCL Oganics ☐ TAL MetCN ☐ Full TCLP ☐ Full App. IX ☐ Part 360 Routine ☐ Part 360 Residue ☐ Part 360 (Residue) Not Below 1000 ☐ NYDEP Sewer ☐ NYDEP Censor ☐ NYDEP Censor Asbestos ☐ TAGM ☐ Silica		☐ Simple Excel ☐ NYSDEC EQULS ☐ EQULS (std) ☐ EZ-EDD (EQULS) ☐ NJDEP SRP HazSite EDD ☐ GIS/KEY (std) ☐ Other ☐ York Regulatory Comparison ☐ Excel Spreadsheet ☐ Compare to the following flags. (please fill in):			
Contact Person: <u>Ther Driscoll</u>		Contact Person: _____		Contact Person: _____		<u>Greenport WFD</u>		☐ Full Poll. ☐ TCL Oganics ☐ TAL MetCN ☐ Full TCLP ☐ Full App. IX ☐ Part 360 Routine ☐ Part 360 Residue ☐ Part 360 (Residue) Not Below 1000 ☐ NYDEP Sewer ☐ NYDEP Censor ☐ NYDEP Censor Asbestos ☐ TAGM ☐ Silica		☐ Simple Excel ☐ NYSDEC EQULS ☐ EQULS (std) ☐ EZ-EDD (EQULS) ☐ NJDEP SRP HazSite EDD ☐ GIS/KEY (std) ☐ Other ☐ York Regulatory Comparison ☐ Excel Spreadsheet ☐ Compare to the following flags. (please fill in):			
E-Mail Address: <u>tdriscoll@environex.com</u>		E-Mail Address: _____		E-Mail Address: _____		<u>Greenport WFD</u>		☐ Full Poll. ☐ TCL Oganics ☐ TAL MetCN ☐ Full TCLP ☐ Full App. IX ☐ Part 360 Routine ☐ Part 360 Residue ☐ Part 360 (Residue) Not Below 1000 ☐ NYDEP Sewer ☐ NYDEP Censor ☐ NYDEP Censor Asbestos ☐ TAGM ☐ Silica		☐ Simple Excel ☐ NYSDEC EQULS ☐ EQULS (std) ☐ EZ-EDD (EQULS) ☐ NJDEP SRP HazSite EDD ☐ GIS/KEY (std) ☐ Other ☐ York Regulatory Comparison ☐ Excel Spreadsheet ☐ Compare to the following flags. (please fill in):			

Print Clearly and Legibly. All Information must be complete.
Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.

Samples Collected/Authorized By (Signature)
Glen Bonkoff
Name (printed)
Glen Bonkoff

Sample Identification	Date/Time Sampled	Sample Matrix	Choose Analyses Needed from the Menu Above and Enter Below	Container Description(s)
Ham by RM 150 - WF	6/20/16 13:21	DW		(1) 200 ml
RM 150 Auto Shop (Middle) - SS	13:22			
RM 151 Tech RM (Middle) - SS	13:23			
Big Gym Boys side - WF	13:24			
RM 152 c Boys Coaches Office BR-SK	13:25			
Big Gym Boys LR - WF	13:26			
Big Gym Boys LR (Right) - SK	13:28			
Hale Bib near Gym Storage - SP	13:29			
RM 109 Superintendent Office BR-SK	13:30			
Coaches RM Ice Mach - SP	13:35			
Comments				
Preservation		Check those Applicable		
4°C		Frozen	HCl	MeOH
HNO ₃		ZnAc	Ascorbic Acid	NaOH
Other		Other		
Special Instructions		Field Filtered ☐ Lab to Filter ☐		
Temperature on Receipt		Date/Time		
4.9 °C		Date/Time		
Samples Received By		Date/Time		
12/20/16 6:30:16 pm		Date/Time		
Samples Relinquished By		Date/Time		
12/20/16 6:30:16 pm		Date/Time		
Samples Relinquished By		Date/Time		
12/20/16 6:30:16 pm		Date/Time		



YORK ANALYTICAL LABORATORIES
120 RESEARCH DR.
STRATFORD, CT 06615
(203) 325-1371
FAX (203) 357-0166

Field Chain-of-Custody Record

Page 5 of 7

NOTE: York's Std. Terms & Conditions are listed on the back side of this document. This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

York Project No. 16F1200

[illegible]



YORK ANALYTICAL LABORATORIES
120 RESEARCH DR.
STRATFORD, CT 06615
(203) 325-1371
FAX (203) 357-0166

Field Chain-of-Custody Record

Page 6 of 7

NOTE: York's Std. Terms & Conditions are listed on the back side of this document.
This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

York Project No. 16F1200

YOUR Information		Report To:		Invoice To:		YOUR Project ID		Turn-Around Time		Report Type	
Company: <u>Environ Science</u>	Company: _____	Company: _____	Company: _____	Company: _____	Company: _____	Company: _____	Company: _____	Company: _____	Company: _____	Company: _____	Company: _____
Address: <u>450 Summit St. Apt. 205</u>	Address: _____	Address: _____	Address: _____	Address: _____	Address: _____	Address: _____	Address: _____	Address: _____	Address: _____	Address: _____	Address: _____
Phone No. <u>631 580-3191</u>	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____
Contact Person: <u>John Driscoll</u>	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____
E-Mail Address: <u>john.driscoll@environsci.com</u>	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____
Print Clearly and Legibly. All Information must be complete. Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.											
Samples Collected/Authorized By (Signature): <u>[Signature]</u> Name (printed): <u>Glen Driscoll</u>											
Matrix Codes S - soil Other - specify (oil, etc.) _____ WW - wastewater GW - groundwater DW - drinking water Air-A - ambient air Air-SV - soil vapor											
Choose Analyses Needed from the Menu Above and Enter Below											
Sample Identification	Date/Time Sampled	Sample Matrix	Container Description(s)								
Boys BR by RM 156-SK	6/29/16 13:48	DW	(1) 250 ml								
Girls BR by RM 156-SK	13:49										
RM 137 Airs BR-SK	13:50										
RM 144 Home Ec Station #1-SK	13:51										
RM 144 Home Ec Station #2-SK	13:52										
RM 144 Home Ec Station #3-SK	13:53										
RM 144 Home Ec Station #4-SK	13:54										
RM 144 Home Ec Station #5-SK	13:55										
Small Gym - WF	13:56										
Kitchen 3 piece - SK	13:57										
Comments			4°C _____ Frozen _____ HCl _____ MeOH _____ HNO₃ _____ H₂SO₄ _____ NaOH _____ Other _____ Preservation Check those Applicable Special Instructions Field Filtered ☐ Lab to Filter ☐								
Temperature on Receipt			Samples Received By <u>[Signature]</u> Date/Time <u>6/30/16 2:50 PM</u> Samples Relinquished By <u>[Signature]</u> Date/Time <u>6/30/16 17:56</u> Samples Received in LAB by <u>[Signature]</u> Date/Time <u>6/30/16 17:56</u> Temperature on Receipt <u>4.9 °C</u>								



YORK ANALYTICAL LABORATORIES
120 RESEARCH DR.
STRATFORD, CT 06615
(203) 325-1371
FAX (203) 357-0166

Field Chain-of-Custody Record

Page 7 of 7

NOTE: York's Std. Terms & Conditions are listed on the back side of this document.

This document serves as your written authorization to York to proceed with the analyses requested and your signature binds you to York's Std. Terms & Conditions.

York Project No. 16F1200

YOUR Information		Report To:		Invoice To:		YOUR Project ID		Turn-Around Time		Report Type	
Company: <u>Environnement</u>	Company: _____	Company: _____	Company: _____	Company: _____	Company: _____	Company: _____	Company: _____	Company: _____	Company: _____	Company: _____	Company: _____
Address: <u>2400 Sunnyside Ave</u>	Address: _____	Address: _____	Address: _____	Address: _____	Address: _____	Address: _____	Address: _____	Address: _____	Address: _____	Address: _____	Address: _____
City/State/Zip: <u>Conkoma, NY 11779</u>	City/State/Zip: _____	City/State/Zip: _____	City/State/Zip: _____	City/State/Zip: _____	City/State/Zip: _____	City/State/Zip: _____	City/State/Zip: _____	City/State/Zip: _____	City/State/Zip: _____	City/State/Zip: _____	City/State/Zip: _____
Phone No. <u>631-580-3141</u>	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____	Phone No. _____
Contact Person: <u>Thon Driscoll</u>	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____	Contact Person: _____
E-Mail Address: <u>tdriscoll@environmet.com</u>	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____	E-Mail Address: _____
Print Clearly and Legibly. All Information must be complete. Samples will NOT be logged in and the turn-around time clock will not begin until any questions by York are resolved.											
Samples Collected/Authorized By (Signature) <u>Glenn Baskett</u>											
Name (Printed) <u>Glenn Baskett</u>											
Choose Analyses Needed from the Menu Above and Enter Below											
Sample Identification	Date/Time Sampled	Sample Matrix	Container Description(s)								
Kitchen SK by Spring Line - SK	6/24/16 13:58	DW	(1) 250 ml								
Kitchen SK next to fridge - SK	14:00										
RM 140 Aids Break RM - SK	14:02										
RM 101 Pre K - SK	14:03										
RM 141 BR - SK	14:04										
RM 102 Pre K - SS	14:05										
Preservation Check those Applicable Special Instructions Field Filtered ☐ Lab to Filter ☐											
Comments											
4°C _____ Frozen _____ HCl _____ MeOH _____ HNO ₃ _____ H ₂ SO ₄ _____ NaOH _____ Other _____ Samples Relinquished By <u>Glenn Baskett</u> Date/Time <u>6/30/16 13:00</u> Samples Relinquished By _____ Date/Time _____ Samples Received in LAB by _____ Date/Time _____ Temperature on Receipt <u>4.9</u> °C											

Second and Third Draw Results

Client: EnviroScience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779

Report No.: 2163523
Project No.: 46603
Lab Batch: C9386

Project: Greenport UFSD
Greenport School

Sampled: 7/22/16
Received: 7/25/16
Analyzed: 7/25/16
Reported: 7/25/16

**Analytical Report for
Lead in Potable Water by EPA 200.9**

Sample No.	Sample Location / Description	Sample Type	MDL (µg/L)	Lead (µg/L)
1	3 rd floor, girl's bath (hands) sink	15 sec.	1.0	<1.0
2	3 rd floor, girl's bath (hands) sink	60 sec.	1.0	<1.0
3	2 nd floor, girl's gang bath (left) sink	15 sec.	1.0	<1.0
4	2 nd floor, girl's gang bath (left) sink	60 sec.	1.0	<1.0
5	1 st floor, girl's gang bath (door) sink	15 sec.	1.0	2.0
6	1 st floor, girl's gang bath (door) sink	60 sec.	1.0	1.1
7	Gym men's bathroom (middle) sink	15 sec.	1.0	2.1
8	Gym men's bathroom (middle) sink	60 sec.	1.0	1.2
9	Gym women's bathroom (left) sink	15 sec.	1.0	9.2
10	Gym women's bathroom (left) sink	60 sec.	1.0	7.9
11	Gym women's BR (middle) sink	15 sec.	1.0	6.5
12	Gym women's BR (middle) sink	60 sec.	1.0	4.5
13	Hall by room 150 WF	15 sec.	1.0	7.1
14	Hall by room 150 WF	60 sec.	1.0	2.6
15	Big gym boy's LR WF	15 sec.	1.0	24



Li Tsang
Laboratory Director

LT:en

The analytical results relate only to the samples tested in the condition received by the laboratory. This report must not be reproduced except in its entirety unless with the laboratory's written approval.

Client: EnviroScience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779


Report No.: 2163523
Project No.: 46603
Lab Batch: C9386

Project: Greenport UFSD
Greenport School

Sampled: 7/22/16
Received: 7/25/16
Analyzed: 7/25/16
Reported: 7/25/16

**Analytical Report for
Lead in Potable Water by EPA 200.9**

Sample No.	Sample Location / Description	Sample Type	MDL (µg/L)	Lead (µg/L)
16	Big gym boy's LR WF	60 sec.	1.0	6.9
17	Hose bib near gym storage spigot	15 sec.	1.0	<1.0
18	Hose bib near gym storage spigot	60 sec.	1.0	<1.0
19	Boy's coach's room, icemaker spigot	15 sec.	1.0	1.8
20	Boy's coach's room, icemaker spigot	60 sec.	1.0	1.3
21	Girl's coach's office bathroom sink	15 sec.	1.0	2.7
22	Girl's coach's office bathroom sink	60 sec.	1.0	<1.0
23	Big gym girl's LR water fountain	15 sec.	1.0	44
24	Big gym girl's LR water fountain	60 sec.	1.0	8.8
25	Big gym girl's LR BR left sink	15 sec.	1.0	2.7
26	Big gym girl's LR BR left sink	60 sec.	1.0	4.7
27	Room 145 WF	15 sec.	1.0	53
28	Room 145 WF	60 sec.	1.0	13
29	Room 146 SK	15 sec.	1.0	17
30	Room 146 SK	60 sec.	1.0	2.1



Li Tsang
Laboratory Director

LT:en

The analytical results relate only to the samples tested in the condition received by the laboratory. This report must not be reproduced except in its entirety unless with the laboratory's written approval.

Client: EnviroScience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779**Report No.:** 2163523
Project No.: 46603
Lab Batch: C9386**Project:** Greenport UFSD
Greenport School**Sampled:** 7/22/16
Received: 7/25/16
Analyzed: 7/25/16
Reported: 7/25/16**Analytical Report for
Lead in Potable Water by EPA 200.9**

Sample No.	Sample Location / Description	Sample Type	MDL (µg/L)	Lead (µg/L)
31	Room 147 WF	15 sec.	1.0	3.2
32	Room 147 WF	60 sec.	1.0	1.5
33	NEADA boy's BR sink	15 sec.	1.0	35
34	NEADA boy's BR sink	60 sec.	1.0	12
35	Boy's BR by room 156 sink	15 sec.	1.0	5.8
36	Boy's BR by room 156 sink	60 sec.	1.0	2.6
37	Kitchen sink next to fridge	15 sec.	1.0	4.9
38	Kitchen sink next to fridge	60 sec.	1.0	<1.0



Li Tsang
Laboratory Director

LT:en

The analytical results relate only to the samples tested in the condition received by the laboratory. This report must not be reproduced except in its entirety unless with the laboratory's written approval.

POTABLE WATER SAMPLING FOR LEAD CONCENTRATION SAMPLE COLLECTION FORM

Acid
added
07/25/16
11:57pm
Page 1 of 8

CLIENT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue Ronkonkoma, NY 11779	
Client Rep: John Driscoll	W.O. No.

CONSULTANT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue. Ronkonkoma, NY 11779	
Project Manager: John Driscoll	Project No.:
Inspector:	Field Tech.: Dan Driscoll

PROJECT INFORMATION

BLDG ID:	BLDG No./Name: Greenport UFSD		BLDG Address: Greenport School						
GEO. DIST.	JUR. DIST.	Sq. Ft. (000):	(0) Year Built	(1) Year 1 st Add.	(2) Year 2 nd Add.	(3) Year 1 st Mod.	(4) Year 2 nd Mod.	DATE OF SAMPLING: 7/22/16	

SAMPLE DATA

Sample Description/ID (ID must match container label)						LOCATION/COORDINATES		Type (Ent)	MFS/ Model	Serial #	Date of Installation	CONTAINER INFO.		SAMPLE TYPE		Length of Flush	Time of Collection	Lead Conc. (ppb)	
Floor	Functional Space Code	IN/BY	Room No.	Construction Code	Sample /Outlet Code							Size	#	Preservatives	Initial	Follow-up			
						3 rd Fl Girls Bath (Hands)		Sink				250 ml	01	HNO ₃		✓	15	0811	<1.0
						"		"				250 ml	02	HNO ₃		✓	60	0812	<1.0
						2 nd Fl Girls Gang Bath (Left)		Sink				250 ml	03	HNO ₃		✓	15	0816	<1.0
						"		"				250 ml	04	HNO ₃		✓	60	0817	<1.0
						1 st Fl Girls gang Bath (door)		Sink				250 ml	05	HNO ₃		✓	15	0820	2.0

CHAIN OF CUSTODY

Relinquished By:	Received By:	Date:	Time:
<i>[Signature]</i>	<i>[Signature]</i>	7/25/16	11:15
I.			
II.			
III.			

LABORATORY INFORMATION

Lab Name: NEW YORK ENVIRONMENTAL AND ANALYTICAL LABS., INC	Date:	Time:	Method of Analysis:
Analyzed By: <i>Anita Lee</i>	7-25-16	1700	200.9
QC By:			
Method of shipment/delivery: ☐ US Mail ☐ UPS ☐ Fed-Ex ☐ Courier			
☐ Hand Delivery ☐ Other:			

INSTRUCTIONS TO THE LABORATORY

Turnaround Time	☐ Analyze follow-up sample(s) ONLY when initial sample exceeds 20ppb	Report Results ASAP To: Judy Buenten
☐ RUSH ☒ 24 HOUR ☐ 48 Hour	☐ Analyze both initial and follow up samples	☐ Phone (631) 580-3191 ☐ Fax:
☐ OTHER:	☐ Other:	☒ Email: jbuenten@envirohealth.org ☐ Mail report to above address
Comments: Copy John Driscoll in e-mail with results at: jdriscoll@envirohealth.org		

POTABLE WATER SAMPLING FOR LEAD CONCENTRATION SAMPLE COLLECTION FORM

Page 2 of 8

CLIENT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue Ronkonkoma, NY 11779	
Client Rep: John Driscoll	W.O. No.

CONSULTANT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue. Ronkonkoma, NY 11779	
Project Manager: John Driscoll	Project No.:
Inspector:	Field Tech.: Don Driscoll



PROJECT INFORMATION

BLDG ID:	BLDG No./Name: Greenport UFSD		BLDG Address: Greenport School					
GEO. DIST.	JUR. DIST.	Sq. Ft. (000):	(0) Year Built	(1) Year 1 st Add.	(2) Year 2 nd Add.	(3) Year 1 st Mod.	(4) Year 2 nd Mod.	DATE OF SAMPLING: 7/22/16

SAMPLE DATA

Sample Description/ID (ID must match container label)						OUTLET INFORMATION				CONTAINER INFO.		SAMPLE TYPE		Length of Flush	Time of Collection	Lead Conc. (ppb)	
Floor	Functional Space Code	IN/BY	Room No.	Construction Code	Sample /Outlet Code	Type (Enter Code)	MFS/ Model	Serial #	Date of Installation	Size	#	Preservatives	Initial				Follow-up
										250 ml	06	HNO ₃		✓	60	0821	1.1
										250 ml	07	HNO ₃		✓	15	0835	2.1
										250 ml	08	HNO ₃		✓	60	0836	1.2
										250 ml	09	HNO ₃		✓	15	0841	9.2
										250 ml	10	HNO ₃		✓	60	0842	7.9

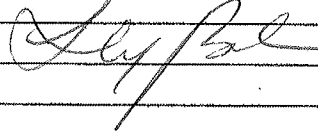CHAIN OF CUSTODY

Relinquished By:	Received By:	Date:	Time:
I. 		7/25/16	115
II.			
III.			

LABORATORY INFORMATION

Lab Name: NEW YORK ENVIRONMENTAL AND ANALYTICAL LABS., INC	Date	Time	Method of Analysis:
Analyzed By: Alvin Lee	07/25/16	17:00	200.9
QC By:			
Method of shipment/delivery: ☐ US Mail ☐ UPS ☐ Fed-Ex ☐ Courier			
☐ Hand Delivery ☐ Other:			

INSTRUCTIONS TO THE LABORATORY

Turnaround Time	☐ Analyze follow-up sample(s) ONLY when initial sample exceeds 20ppb	Report Results ASAP To: Judy Buenten
☐ RUSH ☒ 24 HOUR ☐ 48 HOUR	☐ Analyze both initial and follow up samples	☐ Phone (631) 580-3191 ☐ Fax:
☐ OTHER:	☐ Other:	☒ Email: jbuenten@envirohealth.org ☐ Mail report to above address
Comments: Copy John Driscoll in e-mail with results at: jdriscoll@envirohealth.org		

POTABLE WATER SAMPLING FOR LEAD CONCENTRATION SAMPLE COLLECTION FORM

Page 3 of 8

CLIENT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue Ronkonkoma, NY 11779	
Client Rep: John Driscoll	W.O. No.

CONSULTANT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue. Ronkonkoma, NY 11779	
Project Manager: John Driscoll	Project No.:
Inspector:	Field Tech.: Dan Driscoll



PROJECT INFORMATION

BLDG ID:	BLDG No./Name: Greenport VFSD		BLDG Address: Greenport School					
GEO. DIST.	JUR. DIST.	Sq. Ft. (000):	(0) Year Built	(1) Year 1 st Add.	(2) Year 2 nd Add.	(3) Year 1 st Mod.	(4) Year 2 nd Mod.	DATE OF SAMPLING: 7/22/16

SAMPLE DATA

Sample Description/ID (ID must match container label)						OUTLET INFORMATION				CONTAINER INFO.		SAMPLE TYPE		Length of Flush	Time of Collection	Lead Conc. (ppb)	
Floor	Functional Space Code	IN/BY	Room No.	Construction Code	Sample /Outlet Code	Type (Enter Code)	MFS/ Model	Serial #	Date of Installation	Size	#	Preservatives	Initial				Follow-up
										250 ml	11	HNO ₃		✓	15	0844	6.5
							"			250 ml	12	HNO ₃		✓	60	0845	4.5
							Hall by ^{RM} 150	WF		250 ml	13	HNO ₃		✓	15	0835	7.1
							"	"		250 ml	14	HNO ₃		✓	60	08 ⁴⁷ 34	2.6
							Big Gym Boys LR	WF		250 ml	15	HNO ₃		✓	15	08 ⁴⁸ 34	2.4

CHAIN OF CUSTODY

Relinquished By:	Received By:	Date:	Time:
I. 		7/25/16	11:15
II.			
III.			

LABORATORY INFORMATION

Lab Name: NEW YORK ENVIRONMENTAL AND ANALYTICAL LABS., INC	Date	Time	Method of Analysis:
Analyzed By: Alvin Lee	07/25/16	17:00	200.9
QC By:			
Method of shipment/delivery: ☐ US Mail ☐ UPS ☐ Fed-Ex ☐ Courier			
☐ Hand Delivery ☐ Other:			

INSTRUCTIONS TO THE LABORATORY

Turnaround Time	☐ Analyze follow-up sample(s) ONLY when initial sample exceeds 20ppb	Report Results ASAP To: Judy Buenten
☐ RUSH ☐ 24 HOUR ☐ 48 Hour	☐ Analyze both initial and follow up samples	☐ Phone (631) 580-3191 ☐ Fax:
☐ OTHER:	☐ Other:	☒ Email: jbuente@envirohealth.org ☐ Mail report to above address
Comments: Copy John Driscoll in e-mail with results at: jdriscoll@envirohealth.org		

POTABLE WATER SAMPLING FOR LEAD CONCENTRATION SAMPLE COLLECTION FORM

Page 4 of 8

CLIENT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue Ronkonkoma, NY 11779	
Client Rep: John Driscoll	W.O. No.

CONSULTANT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue. Ronkonkoma, NY 11779	
Project Manager: John Driscoll	Project No.:
Inspector:	Field Tech.: Dan Driscoll



PROJECT INFORMATION

BLDG ID:	BLDG No./Name: Greenport LKSD		BLDG Address: Greenport School					
GEO. DIST.	JUR. DIST.	Sq. Ft. (000):	(0) Year Built	(1) Year 1 st Add.	(2) Year 2 nd Add.	(3) Year 1 st Mod.	(4) Year 2 nd Mod.	DATE OF SAMPLING: 7/22/16

SAMPLE DATA

Sample Description/ID (ID must match container label)						OUTLET INFORMATION				CONTAINER INFO.		SAMPLE TYPE		Length of Flush	Time of Collection	Lead Conc. (ppb)	
Floor	Functional Space Code	IN/BY	Room No.	Construction Code	Sample /Outlet Code	Type (Enter Code)	MFS/ Model	Serial #	Date of Installation	Size	#	Preservatives	Initial				Follow-up
										250 ml	16	HNO ₃		✓	60	0851	6.9
										250 ml	17	HNO ₃		✓	15	1015	<1.0
										250 ml	18	HNO ₃		✓	60	1016	<1.0
										250 ml	19	HNO ₃		✓	15	0900	1.8
										250 ml	20	HNO ₃		✓	60	0901	1.3

CHAIN OF CUSTODY

Relinquished By:	Received By:	Date:	Time:
I. 		7/25/16	11T
II.			
III.			

LABORATORY INFORMATION

Lab Name: NEW YORK ENVIRONMENTAL AND ANALYTICAL LABS., INC	Date	Time	Method of Analysis:
Analyzed By: Alvin Lee	07/25/16	17:00	200.9
QC By:			
Method of shipment/delivery: ☐ US Mail ☐ UPS ☐ Fed-Ex ☐ Courier			
☐ Hand Delivery ☐ Other:			

INSTRUCTIONS TO THE LABORATORY

Turnaround Time	☐ Analyze follow-up sample(s) ONLY when initial sample exceeds 20ppb	Report Results ASAP To: Judy Buenten
☐ RUSH ☒ 24 HOUR ☐ 48 Hour	☐ Analyze both initial and follow up samples	☐ Phone (631) 580-3191 ☐ Fax:
☐ OTHER:	☐ Other:	☒ Email: jbuente@envirohealth.org ☐ Mail report to above address
Comments: Copy John Driscoll in e-mail with results at: jdriscoll@envirohealth.org		

POTABLE WATER SAMPLING FOR LEAD CONCENTRATION SAMPLE COLLECTION FORM

Page 5 of 8

CLIENT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue Ronkonkoma, NY 11779	
Client Rep: John Driscoll	W.O. No.

CONSULTANT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue. Ronkonkoma, NY 11779	
Project Manager: John Driscoll	Project No.:
Inspector:	Field Tech.: Dan Driscoll

PROJECT INFORMATION

BLDG ID:	BLDG No./Name: Greenport UFSD		BLDG Address: Greenport School					
GEO. DIST.	JUR. DIST.	Sq. Ft. (000):	(0) Year Built	(1) Year 1 st Add.	(2) Year 2 nd Add.	(3) Year 1 st Mod.	(4) Year 2 nd Mod.	DATE OF SAMPLING: 7/22/16

SAMPLE DATA

Sample Description/ID (ID must match container label)						OUTLET INFORMATION				CONTAINER INFO.		SAMPLE TYPE		Length of Flush	Time of Collection	Lead Conc. (ppb)	
Floor	Functional Space Code	IN/BY	Room No.	Construction Code	Sample /Outlet Code	Type (Enter Code)	MFS/ Model	Serial #	Date of Installation	Size	#	Preservatives	Initial				Follow-up
										250 ml	21	HNO ₃	2.7	✓	15	0926	4.4
										250 ml	22	HNO ₃	1.0	✓	60	0927	4.4
										250 ml	23	HNO ₃		✓	15	0930	4.4
										250 ml	24	HNO ₃		✓	60	0931	8.8
										250 ml	25	HNO ₃		✓	15	0934	2.7

CHAIN OF CUSTODY

Relinquished By:	Received By:	Date:	Time:
I.		7/25/16	11:15
II.			
III.			

LABORATORY INFORMATION

Lab Name: NEW YORK ENVIRONMENTAL AND ANALYTICAL LABS., INC	Date	Time	Method of Analysis:
Analyzed By: Alvin Lee	07/25/16	17:00	200.9
QC By:			
Method of shipment/delivery: ☐ US Mail ☐ UPS ☐ Fed-Ex ☐ Courier			
☐ Hand Delivery ☐ Other:			

INSTRUCTIONS TO THE LABORATORY

Turnaround Time	☐ Analyze follow-up sample(s) ONLY when initial sample exceeds 20ppb	Report Results ASAP To: Judy Buenten
☐ RUSH ☐ 24 HOUR ☐ 48 HOUR	☐ Analyze both initial and follow up samples	☐ Phone (631) 580-3191 ☐ Fax:
☐ OTHER:	☐ Other:	☒ Email: jbuente@envirohealth.org ☐ Mail report to above address
Comments: Copy John Driscoll in e-mail with results at: jdriscoll@envirohealth.org		

POTABLE WATER SAMPLING FOR LEAD CONCENTRATION SAMPLE COLLECTION FORM

Page 6 of 8

CLIENT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue Ronkonkoma, NY 11779	
Client Rep: John Driscoll	W.O. No.

CONSULTANT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue. Ronkonkoma, NY 11779	
Project Manager: John Driscoll	Project No.:
Inspector:	Field Tech.: Don Driscoll

PROJECT INFORMATION

BLDG ID:	BLDG No./Name: Greenport UFSD		BLDG Address: Greenport School						
GEO. DIST.	JUR. DIST.	Sq. Ft. (000):	(0) Year Built	(1) Year 1 st Add.	(2) Year 2 nd Add.	(3) Year 1 st Mod.	(4) Year 2 nd Mod.	DATE OF SAMPLING: 7/22/16	

SAMPLE DATA

Sample Description/ID (ID must match container label)						OUTLET INFORMATION				CONTAINER INFO.		SAMPLE TYPE		Length of Flush	Time of Collection	Lead Conc. (ppb)		
Floor	Functional Space Code	IN/BY	Room No.	Construction Code	Sample /Outlet Code	SAMPLED OUTLET LOCATION/ COORDINATES	Type (Enter Code)	MFS/ Model	Serial #	Date of Installation	Size	#	Preservatives				Initial	Follow-up
						Big Gym Girls BR		Left	Sink		250 ml	26	HNO ₃		✓	60	0935	4.7
						Room 145 Sink					250 ml	27	HNO ₃		✓	15	0942	53
						"					250 ml	28	HNO ₃		✓	60	0943	13
						Room 146 WF					250 ml	29	HNO ₃		✓	15	0944	17
						"					250 ml	30	HNO ₃		✓	60	0945	2.1

CHAIN OF CUSTODY

Relinquished By:	Received By:	Date:	Time:
I.		7/27/16	115
II.			
III.			

LABORATORY INFORMATION

Lab Name: NEW YORK ENVIRONMENTAL AND ANALYTICAL LABS., INC	Date	Time	Method of Analysis:
Analyzed By: Alvin Lee	07/25/16	17:00	200.9
QC By:			
Method of shipment/delivery: ☐ US Mail ☐ UPS ☐ Fed-Ex ☐ Courier			
☐ Hand Delivery ☐ Other:			

INSTRUCTIONS TO THE LABORATORY

Turnaround Time	☐ Analyze follow-up sample(s) ONLY when initial sample exceeds 20ppb	Report Results ASAP To: Judy Buenten
☐ RUSH ☒ 24 HOUR ☐ 48 Hour	☐ Analyze both initial and follow up samples	☐ Phone (631) 580-3191 ☐ Fax:
☐ OTHER:	☐ Other:	☒ Email: jbuente@envirohealth.org ☐ Mail report to above address
Comments: Copy John Driscoll in e-mail with results at: jdriscoll@envirohealth.org		

POTABLE WATER SAMPLING FOR LEAD CONCENTRATION SAMPLE COLLECTION FORM

Page 7 of 8

CLIENT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue Ronkonkoma, NY 11779	
Client Rep: John Driscoll	W.O. No.

CONSULTANT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue. Ronkonkoma, NY 11779	
Project Manager: John Driscoll	Project No.:
Inspector:	Field Tech.: D Driscoll



PROJECT INFORMATION

BLDG ID:	BLDG No./Name: Greenport UFSD		BLDG Address: Greenport School						
GEO. DIST.	JUR. DIST.	Sq. Ft. (000):	(0) Year Built	(1) Year 1 st Add.	(2) Year 2 nd Add.	(3) Year 1 st Mod.	(4) Year 2 nd Mod.	DATE OF SAMPLING: 7/22/16	

SAMPLE DATA

Sample Description/ID (ID must match container label)						OUTLET INFORMATION				CONTAINER INFO.		SAMPLE TYPE		Length of Flush	Time of Collection	Lead Conc. (ppb)	
Floor	Functional Space Code	IN/BY	Room No.	Construction Code	Sample /Outlet Code	Type (Enter Code)	MFS/ Model	Serial #	Date of Installation	Size	#	Preservatives	Initial				Follow-up
										250 ml	31	HNO ₃		✓	15	0939	3.2
										250 ml	32	HNO ₃		✓	60	0940	1.5
										250 ml	33	HNO ₃		✓	15	0942	35
										250 ml	34	HNO ₃		✓	60	0943	12
										250 ml	35	HNO ₃		✓	15	0944	5.8

CHAIN OF CUSTODY

Relinquished By:	Received By:	Date:	Time:
I. 		7/25/16	11:15
II.			
III.			

LABORATORY INFORMATION

Lab Name: NEW YORK ENVIRONMENTAL AND ANALYTICAL LABS., INC	Date	Time	Method of Analysis:
Analyzed By: Alvin Lee	07/25/16	17:00	200.9
QC By:			
Method of shipment/delivery: ☐ US Mail ☐ UPS ☐ Fed-Ex ☐ Courier			
☐ Hand Delivery ☐ Other:			

INSTRUCTIONS TO THE LABORATORY

Turnaround Time	☐ Analyze follow-up sample(s) ONLY when initial sample exceeds 20ppb	Report Results ASAP To: Judy Buenten
☐ RUSH ☒ 24 HOUR ☐ 48 Hour	☐ Analyze both initial and follow up samples	☐ Phone (631) 580-3191 ☐ Fax:
☐ OTHER:	☐ Other:	☒ Email: jbuenten@envirohealth.org ☐ Mail report to above address
Comments: Copy John Driscoll in e-mail with results at: jdriscoll@envirohealth.org		

POTABLE WATER SAMPLING FOR LEAD CONCENTRATION SAMPLE COLLECTION FORM

Page 8 of 8

CLIENT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue Ronkonkoma, NY 11779	
Client Rep: John Driscoll	W.O. No.

CONSULTANT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue. Ronkonkoma, NY 11779	
Project Manager: John Driscoll	Project No.:
Inspector:	Field Tech.: Dan Driscoll



PROJECT INFORMATION

BLDG ID:	BLDG No./Name: Greenport UFSD		BLDG Address: Greenport School					
GEO. DIST.	JUR. DIST.	Sq. Ft. (000):	(0) Year Built	(1) Year 1 st Add.	(2) Year 2 nd Add.	(3) Year 1 st Mod.	(4) Year 2 nd Mod.	DATE OF SAMPLING: 7/22/16

SAMPLE DATA

Sample Description/ID (ID must match container label)						OUTLET INFORMATION				CONTAINER INFO.		SAMPLE TYPE		Length of Flush	Time of Collection	Lead Conc. (ppb)	
Floor	Functional Space Code	IN/BY	Room No.	Construction Code	Sample /Outlet Code	Type (Enter Code)	MFS/ Model	Serial #	Date of Installation	Size	#	Preservatives	Initial				Follow-up
							Boys Bathroom	Rm 156	Sink		250 ml	36	HNO ₃		✓ 60	0945	2.6
							Kitchen Sink next to	Fridge	Sink		250 ml	37	HNO ₃		✓ 15	0959	4.9
							"	"	Sink		250 ml	38	HNO ₃		✓ 60	1000	4.0
										250 ml			HNO ₃				
										250 ml			HNO ₃				

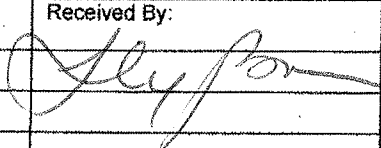CHAIN OF CUSTODY

Relinquished By:	Received By:	Date:	Time:
I. 		7/25/16	11:15
II.			
III.			

LABORATORY INFORMATION

Lab Name: NEW YORK ENVIRONMENTAL AND ANALYTICAL LABS, INC	Date:	Time:	Method of Analysis:
Analyzed By: Alvin Lee	07/25/16	17:00	200.9
QC By:			
Method of shipment/delivery: ☐ US Mail ☐ UPS ☐ Fed-Ex ☐ Courier			
☐ Hand Delivery ☐ Other:			


INSTRUCTIONS TO THE LABORATORY

Turnaround Time	☐ Analyze follow-up sample(s) ONLY when initial sample exceeds 20ppb	Report Results ASAP To: Judy Buenten
☐ RUSH ☒ 24 HOUR ☐ 48 Hour	☐ Analyze both initial and follow up samples	☐ Phone (631) 580-3191 ☐ Fax:
☐ OTHER:	☐ Other:	☒ Email: jbuente@envirohealth.org ☐ Mail report to above address
Comments: Copy John Driscoll in e-mail with results at: jdriscoll@envirohealth.org		

Second and Third Draw Results

Client: EnviroScience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779**Report No.:** 2163829
Project No.: 46754
Lab Batch: C9582**Project:** Greenport UFSD
Greenport Jr/Sr High School**Sampled:** 8/5/16
Received: 8/8/16
Analyzed: 8/9/16
Reported: 8/9/16**Analytical Report for
Lead in Potable Water by EPA 200.9**

Sample No.	Sample Location / Description	Sample Type	MDL (µg/L)	Lead (µg/L)
1	NURSE OFFICE SK	Initial	1.0	10
2	NURSE OFFICE SK	15 Sec. Follow-Up	1.0	<1.0
3	NURSE OFFICE SK	60 Sec. Follow-Up	1.0	<1.0
4	NURSE OFFICE BR SK	Initial	1.0	2.9
5	NURSE OFFICE BR SK	15 Sec. Follow-Up	1.0	1.9
6	NURSE OFFICE BR SK	60 Sec. Follow-Up	1.0	1.4
7	KITCHEN HANDWASHING SK	Initial	1.0	6.9
8	KITCHEN HANDWASHING SK	15 Sec. Follow-Up	1.0	<1.0
9	KITCHEN HANDWASHING SK	60 Sec. Follow-Up	1.0	<1.0


Li Tsang
Laboratory Director

LT:en

The analytical results relate only to the samples tested in the condition received by the laboratory. This report must not be reproduced except in its entirety unless with the laboratory's written approval.

POTABLE WATER SAMPLING FOR LEAD CONCENTRATION SAMPLE COLLECTION FORM

Page 1 of 2

CLIENT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue Ronkonkoma, NY 11779	
Client Rep: John Driscoll	W.O. No.

CONSULTANT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue. Ronkonkoma, NY 11779	
Project Manager: John Driscoll	Project No.:
Inspector:	Field Tech.: Dan Driscoll

PROJECT INFORMATION

BLDG ID:	BLDG No./Name: Greenport UFSD		BLDG Address: Greenport Jr/Sr High School					
GEO. DIST.	JUR. DIST.	Sq. Ft. (000):	(0) Year Built	(1) Year 1 st Add.	(2) Year 2 nd Add.	(3) Year 1 st Mod.	(4) Year 2 nd Mod.	DATE OF SAMPLING: 8/5/16

SAMPLE DATA

Sample Description/ID (ID must match container label)										CONTAINER INFO.		SAMPLE TYPE		Length of Flush	Time of Collection	Lead Conc. (ppb)		
Floor	Functional Space Code	IN/BY	Room No.	Construction Code	Sample /Outlet Code	SAMPLED OUTLET LOCATION/ COORDINATES	Type (Enter Code)	MFS/ Model	Serial #	Date of Installation	Size	#	Preservatives				Initial	Follow-up
						Nurse Office (Initial)	DW	SK			250 ml	1	HNO ₃	X		11:08	10	
						Nurse Office (15 sec)	DW	SK			250 ml	2	HNO ₃		X	15	11:08	<1.0
						Nurse Office (60 sec)	DW	SK			250 ml	3	HNO ₃		X	60	11:09	↓
						Nurse Office BR (Initial)	DW	SK			250 ml	4	HNO ₃	X		11:11	2.9	
						Nurse Office BR (15 sec)	DW				250 ml	5	HNO ₃		X	15	11:11	1.9

CHAIN OF CUSTODY

Relinquished By:	Received By:	Date:	Time:
I. <i>[Signature]</i>	<i>[Signature]</i>	8/5/16	11:30
II.			
III.			

LABORATORY INFORMATION

Lab Name: NEW YORK ENVIRONMENTAL AND ANALYTICAL LABS., INC	Date	Time	Method of Analysis:
Analyzed By: Alvin Lee	08/09/16	12:30pm	200.9
QC By:			
Method of shipment/delivery: ☐ US Mail ☐ UPS ☐ Fed-Ex ☐ Courier			
☐ Hand Delivery ☐ Other:			

INSTRUCTIONS TO THE LABORATORY

Turnaround Time	☐ Analyze follow-up sample(s) ONLY when initial sample exceeds 20ppb	Report Results ASAP To: Judy Buenten
☐ RUSH ☐ 24 HOUR ☐ 48 Hour	☐ Analyze both initial and follow up samples	☐ Phone (631) 580-3191 ☐ Fax:
☐ OTHER:	☐ Other:	☒ Email: jbuente@envirohealth.org ☐ Mail report to above address
Comments: Copy John Driscoll in e-mail with results at: jdriscoll@envirohealth.org		

POTABLE WATER SAMPLING FOR LEAD CONCENTRATION SAMPLE COLLECTION FORM

Page 2 of 2

CLIENT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue Ronkonkoma, NY 11779	
Client Rep: John Driscoll	W.O. No.

CONSULTANT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue. Ronkonkoma, NY 11779	
Project Manager: John Driscoll	Project No.:
Inspector:	Field Tech.: Jan Driscoll

PROJECT INFORMATION

BLDG ID:	BLDG No./Name: Greenport UFSD		BLDG Address: Greenport Jr/Sr High School					
GEO. DIST.	JUR. DIST.	Sq. Ft. (000):	(0) Year Built	(1) Year 1 st Add.	(2) Year 2 nd Add.	(3) Year 1 st Mod.	(4) Year 2 nd Mod.	DATE OF SAMPLING: 8/5/16

SAMPLE DATA

Sample Description/ID (ID must match container label)							OUTLET INFORMATION			CONTAINER INFO.		SAMPLE TYPE		Length of Flush	Time of Collection	Lead Conc. (ppb)			
Floor	Functional Space Code	IN/BY	Room No.	Construction Code	Sample /Outlet Code	SAMPLED OUTLET LOCATION/ COORDINATES	Type (Enter Code)	MFS/ Model	Serial #	Date of Installation	Size	#	Preservatives				Initial	Follow-up	
						Nurse Office BR	DN	SK				250 ml	6	HNO ₃		X	60	11:12	1.4
						Kitchen Handwashing	DN	SK				250 ml	7	HNO ₃	X			11:32	6.9
						Kitchen Handwashing	DN	SK				250 ml	8	HNO ₃		X	15	11:32	<1.0
						Kitchen Handwashing	DN	SK				250 ml	9	HNO ₃		X	60	11:33	↓
												250 ml		HNO ₃					

CHAIN OF CUSTODY

Relinquished By:	Received By:	Date:	Time:
I.		8/5/16	1:03
II.			
III.			

LABORATORY INFORMATION

Lab Name: NEW YORK ENVIRONMENTAL AND ANALYTICAL LABS., INC	Date	Time	Method of Analysis:
Analyzed By: Alvin Lee	08/09/16	12:30pm	200.9
QC By:			
Method of shipment/delivery: ☐ US Mail ☐ UPS ☐ Fed-Ex ☐ Courier			
☐ Hand Delivery ☐ Other:			

INSTRUCTIONS TO THE LABORATORY

Turnaround Time	☐ Analyze follow-up sample(s) <u>ONLY</u> when initial sample exceeds 20ppb	Report Results ASAP To: Judy Buenten
☐ RUSH ☐ 24 HOUR ☐ 48 Hour	☐ Analyze both initial and follow up samples	☐ Phone (631) 580-3191 ☐ Fax:
☐ OTHER:	☐ Other:	☒ Email: jbuente@envirohealth.org ☐ Mail report to above address
Comments: Copy John Driscoll in e-mail with results at: jdriscoll@envirohealth.org		

Post Remediation Test Results

Client: EnviroScience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779


Report No.: 2164537
Project No.: 46603
Lab Batch: C9979

Project: Greenport School

Sampled: 9/2/16
Received: 9/2/16
Analyzed: 9/3/16
Reported: 9/6/16

**Analytical Report for
Lead in Potable Water by EPA 200.9**

Sample No.	Sample Location / Description	Sample Type	MDL (µg/L)	Lead (µg/L)
1	3 rd FLOOR GIRLS BR (HANDS) SK	Initial	1.0	162
2	2 ND FLOOR GANG BR (LEFT) SK	Initial	1.0	17
3	GYM MENS BR (MIDDLE) SK	Initial	1.0	8.2
4	GYM WOMENS BR (LEFT) SK	Initial	1.0	2120
5	GYM WOMENS BR (MIDDLE) SK	Initial	1.0	337
6	BOYS COACHES ROOM ICE MACHINE SP	Initial	1.0	<1.0
7	HOSE BIB NEAR GYM STORAGE SP	Initial	1.0	3.0
8	BIG GYM GIRLS LR BR (LEFT) SK	Initial	1.0	42
9	GIRLS COACH'S OFFICE BR SK	Initial	1.0	51
10	ROOM 146 SK	Initial	1.0	28
11	NE ADA BR SK	Initial	1.0	22
12	KITCHEN SK NEXT TO FRIDGE	Initial	1.0	60


Li Tsang
Laboratory Director

LT:en

The analytical results relate only to the samples tested in the condition received by the laboratory. This report must not be reproduced except in its entirety unless with the laboratory's written approval.

POTABLE WATER SAMPLING FOR LEAD CONCENTRATION SAMPLE COLLECTION FORM

Page 2 of 3

CLIENT INFORMATION

Name: **Enviroscience Consultants, Inc**
 Address: **2150 Smithtown Avenue
Ronkonkoma, NY 11779**
 Client Rep: **John Driscoll** W.O. No.

CONSULTANT INFORMATION

Name: **Enviroscience Consultants, Inc**
 Address: **2150 Smithtown Avenue, Ronkonkoma, NY 11779**
 Project Manager: **John Driscoll** Project No.
 Inspector: **John Driscoll** Field Tech: **John Driscoll**

PROJECT INFORMATION

BLDG ID: BLDG No./Name: **Greenport School** BLDG Address:
 GEO. DIST. JUR. DIST. Sq. Ft. (000): (0) Year Built (1) Year 1st Add. (2) Year 2nd Add. (3) Year 1st Mod. (4) Year 2nd Mod. DATE OF SAMPLING: **9/2/16**

SAMPLE DATA

Sample Description/ID (ID must match container label)				OUTLET INFORMATION		CONTAINER INFO.		SAMPLE TYPE		Lead Conc. (ppb)								
Floor	Functional Space Code	IN/BY	Room No.	Construction Code	Sample /Outlet Code	SAMPLED OUTLET LOCATION/ COORDINATES	Type (Enter Code)	MFS/ Model	Serial #		Date of Installation	Size	#	Preservatives	Initial	Follow-up	Length of Flush	Time of Collection
						Bays Cade Room Tea Machine	SP				250 ml	6	HNO ₃	✓			0907	<1.0
						Hose Bivener gun storage	SP				250 ml	7	HNO ₃	✓			0910	3.0
						Big Gym Girls LR	SK				250 ml	8	HNO ₃	✓			0911	42
						Girls Coach's Office BR	SK				250 ml	9	HNO ₃	✓			0916	51
						Room 146	SK				250 ml	10	HNO ₃	✓			0918	28

CHAIN OF CUSTODY

Relinquished By: **[Signature]** Received By: **[Signature]** Date: **9/2/16** Time: **1300**

LABORATORY INFORMATION

Lab Name: **NEW YORK ENVIRONMENTAL AND ANALYTICAL LABS, INC** Date: **9/2/16** Time: **1300** Method of Analysis: **200.9**
 Analyzed By: **[Signature]** QC By: **[Signature]** Method of shipment/delivery: ☐ US Mail ☐ UPS ☐ Fed-Ex ☐ Courier
☐ Hand Delivery ☐ Other: **[Signature]**

INSTRUCTIONS TO THE LABORATORY

Turnaround Time: ☒ RUSH ☒ 24 HOUR ☐ 48 Hour ☐ Analyze follow-up sample(s) ONLY when initial sample exceeds 20ppb Report Results ASAP To: **Judy Buenten**
☐ OTHER: ☐ Analyze both initial and follow up samples ☐ Phone **(631) 580-3191** ☐ Fax: **[Signature]**
 Comments: **Copy John Driscoll in e-mail with results at: jdriscoll@envirohealth.org** ☒ E-mail: **jbuenten@envirohealth.org** ☐ Mail report to above address

POTABLE WATER SAMPLING FOR LEAD CONCENTRATION SAMPLE COLLECTION FORM

CLIENT INFORMATION

Name: **Enviroscience Consultants, Inc**
 Address: **2150 Smithtown Avenue
Ronkonkoma, NY 11779**
 Client Rep: **John Driscoll** W.O. No. _____

CONSULTANT INFORMATION

Name: **Enviroscience Consultants, Inc**
 Address: **2150 Smithtown Avenue, Ronkonkoma, NY 11779**
 Project Manager: **John Driscoll** Project No.: _____
 Inspector: _____ Field Tech: **John Driscoll**

PROJECT INFORMATION

BLDG ID: _____ BLDG No./Name: **Greenport School** BLDG Address: _____
 GEO. DIST. _____ JUR. DIST. _____ Sq. Ft. (000): _____ (0) Year Built _____ (1) Year 1st Add. _____ (2) Year 2nd Add. _____ (3) Year 1st Mod. _____ (4) Year 2nd Mod. _____
 DATE OF SAMPLING: **9/2/16**

SAMPLE DATA

Sample Description/ID (ID must match container label)				OUTLET INFORMATION		CONTAINER INFO.		SAMPLE TYPE		Lead Conc. (ppb)								
Floor	Functional Space Code	IN/BY	Room No.	Construction Code	Sample /Outlet Code	Type (Enter Code)	MFS/Model	Serial #	Date of Installation		Size	#	Preservatives	Initial	Follow-up	Length of Flush	Time of Collection	
										250 ml	11		HNO ₃	✓			0921	22
										250 ml	12		HNO ₃	✓			0925	60
										250 ml			HNO ₃					
										250 ml			HNO ₃					
										250 ml			HNO ₃					
										250 ml			HNO ₃					

CHAIN OF CUSTODY

Relinquished By: _____ Received By: _____ Date: **9/2/16** Time: **1:30**
 I. **[Signature]**
 II. _____
 III. _____

LABORATORY INFORMATION

Lab Name: **NEW YORK ENVIRONMENTAL AND ANALYTICAL LABS, INC** Date: _____
 Analyzed By: _____
 QC By: _____
 Method of shipment/delivery: ☐ Hand Delivery ☐ Other: ☐ US Mail ☐ UPS ☐ Fed-Ex ☐ Courier
 Report Results ASAP To: **Judy Buenten**


INSTRUCTIONS TO THE LABORATORY

Turnaround Time ☐ RUSH ☒ 24 HOUR ☐ 48 Hour ☐ Analyze follow-up sample(s) ONLY when initial sample exceeds 20ppb ☐ Analyze both initial and follow up samples
☐ OTHER: _____
 Comments: **Copy John Driscoll in e-mail with results at: jdriscoll@envirohealth.org**

Client: EnviroScience Consultants, Inc.
2150 Smithtown Avenue
Ronkonkoma, NY 11779**Report No.:** 2164723
Project No.: 47137
Lab Batch: C10115**Project:** Greenport UFSD
Greenport School**Sampled:** 9/9/16
Received: 9/9/16
Analyzed: 9/10/16
Reported: 9/12/16

**Analytical Report for
Lead in Potable Water by EPA 200.9**

Sample No.	Sample Location / Description	Sample Type	MDL (µg/L)	Lead (µg/L)
1	3 rd FLOOR GIRLS BR (HANDS) - SK	Initial	1.0	<1.0
2	2ND FLOOR GIRLS BR (LEFT) - SK	Initial	1.0	<1.0
3	KITCHEN SK NEXT TO FRIDGE	Initial	1.0	<1.0
4	NE ADA BR - SK	Initial	1.0	<1.0
5	BIG GYM GIRLS LR BR (LEFT) - SK	Initial	1.0	1.8
6	GIRLS COACHES OFFICE BR - SK	Initial	1.0	<1.0
7	ROOM 146 - SK	Initial	1.0	<1.0
8	GYM WOMENS BR (LEFT) - SK	Initial	1.0	1.0
9	GYM WOMENS BR (MIDDLE) - SK	Initial	1.0	<1.0



Li Tsang
Laboratory Director

LT:en

The analytical results relate only to the samples tested in the condition received by the laboratory. This report must not be reproduced except in its entirety unless with the laboratory's written approval.

47137

CONSULTANT INFORMATION

Name: **Enviroscience Consultants, Inc.**

Address: 2150 Smithtown Avenue, Ronkonkoma, NY 11779	
Project Manager: John Driscoll	Project 13

Eliaid Tech: Glen Bernhof

Greenport School

DATE OF SAMPLING:

C 10115

C 10115

LOCATION/
COORDINATES

Lead
Conc.
(ppb)

Sample Description/ID (ID must match container label)		OUTLET INFORMATION		CONTAINER INFO.		SAMPLE TYPE									
Floor	Functional Space Code	IN/BY	Room No.	Type (Enter Code)	MFS/ Model	Serial #	Date of Installation	Size	#	Preservatives	Initial	Follow-up	Length of Flush	Time of Collection	Lead Conc. (ppb)
								250 ml	1	HNO ₃	X			6:00	<1.0
								250 ml	2	HNO ₃	X			6:03	<1.0
								250 ml	3	HNO ₃	X			6:06	<1.0
								250 ml	4	HNO ₃	X			6:10	<1.0
								250 ml	5	HNO ₃	X			6:13	<1.8

Method

I.	Bo Rops		
II.	Bo Rops	July 2nd	1635
III.			

.....

1

Abstract

Comments: Copy John Driscoll in e-mail with results at: jdriscoll@envirohealth.org

Project	13926
---------	-------

POTABLE WATER SAMPLING FOR LEAD CONCENTRATION SAMPLE COLLECTION FORM

Page 2 of 2

CLIENT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue Ronkonkoma, NY 11779	
Client Rep: John Driscoll	W.O. No.

CONSULTANT INFORMATION

Name: Enviroscience Consultants, Inc	
Address: 2150 Smithtown Avenue, Ronkonkoma, NY 11779	
Project Manager: John Driscoll	Project No.: 13926
Inspector:	Field Tech: Glen Bornhoft

PROJECT INFORMATION

BLDG ID:	BLDG No./Name: Greenport UFSD		BLDG Address: Greenport School	
GEO. DIST.	JUR. DIST.	Sq. Ft. (000):	(0) Year Built	(1) Year 1 st Add.
			(2) Year 2 nd Add.	(3) Year 1 st Mod.
			(4) Year 2 nd Mod.	DATE OF SAMPLING: 9/9/2016

SAMPLE DATA

Sample Description/ID (ID must match container label)				OUTLET INFORMATION		CONTAINER INFO.		SAMPLE TYPE		Length of Flush		Lead Conc. (ppb)						
Floor	Functional Space Code	IN/BY	Room No.	Construction Code	Sample /Outlet Code	SAMPLED OUTLET LOCATION/ COORDINATES	Type (Enter Code)	MFS/ Model	Serial #	Date of Installation	Size	#	Preservatives	Initial	Follow-up	Time of Collection		
						G-16 Coaches Office BR-Sk					250 ml	6	HNO ₃	X			6:14	<1.0
						Room 146-Sk					250 ml	7	HNO ₃	X			6:16	<1.0
						Gym lockers RR (left) -Sk					250 ml	8	HNO ₃	X			6:20	1.0
						Gym lockers RR (middle) -Sk					250 ml	9	HNO ₃	X			6:21	<1.0
											250 ml		HNO ₃					

CHAIN OF CUSTODY

Relinquished By:	Received By:	Date:	Time:
<i>[Signature]</i>	<i>[Signature]</i>	9/9/16	1038
I.			
II.			
III.			

INSTRUCTIONS TO THE LABORATORY

Turnaround Time	☐ Analyze follow-up sample(s) ONLY when initial sample exceeds 20ppb	Report Results ASAP To: Judy Buenten
☐ RUSH ☐ 24 HOUR ☐ 48 Hour	☐ Analyze both initial and follow up samples	☐ Phone (631) 580-3191 ☐ Fax:
☐ OTHER:	☐ Other:	☒ Email: jbuente@envirohealth.org ☐ Mail report to above address
Comments: Copy John Driscoll in e-mail with results at: jdriscoll@envirohealth.org		

LABORATORY INFORMATION

Lab Name: NEW YORK ENVIRONMENTAL AND ANALYTICAL LABS, INC	Date	Time	Method of Analysis: 200.9
Analyzed By:			
QC By:			
Method of shipment/delivery:	☐ US Mail ☐ UPS ☐ Fed-Ex ☐ Courier		
☒ Hand Delivery ☐ Other:			

Appendix B
Lab Certifications

NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2017
Issued April 01, 2016

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. LI TSANG
NY ENVIRONMENTAL AND ANALYTICAL LABS INC
88 HARBOR ROAD
PORT WASHINGTON, NY 11050

NY Lab Id No: 11510

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2003) for the category
ENVIRONMENTAL ANALYSES NON POTABLE WATER
All approved analytes are listed below:*

Bacteriology

Heterotrophic Plate Count SimPlate

Metals I

Lead, Total SM 3111B-99,-11

Miscellaneous


Turbidity SM 2130 B-01,-11

Polychlorinated Biphenyls

PCB-1016	EPA 8082A
PCB-1221	EPA 8082A
PCB-1232	EPA 8082A
PCB-1242	EPA 8082A
PCB-1248	EPA 8082A
PCB-1254	EPA 8082A
PCB-1260	EPA 8082A

Sample Preparation Methods

EPA 3535A



Department
of Health

Serial No.: 54300

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2017
Issued April 01, 2016

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. ROBERT Q. BRADLEY
YORK ANALYTICAL LABORATORIES INC
120 RESEARCH DRIVE
STRATFORD, CT 06615

NY Lab Id No: 10854

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2003) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:

Fuel Additives

Methyl tert-butyl ether	EPA 524.2
Naphthalene	EPA 524.2

Metals I

Arsenic, Total	EPA 200.8 Rev. 5.4
Barium, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4
Cadmium, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4
Chromium, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4
Copper, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4
Iron, Total	EPA 200.7 Rev. 4.4
Lead, Total	EPA 200.8 Rev. 5.4
Manganese, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4
Mercury, Total	EPA 245.1 Rev. 3.0
Selenium, Total	EPA 200.8 Rev. 5.4
Silver, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4
Zinc, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4

Metals II

Aluminum, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4

Metals II

Antimony, Total	EPA 200.8 Rev. 5.4
Beryllium, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4
Molybdenum, Total	EPA 200.8 Rev. 5.4
Nickel, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4
Thallium, Total	EPA 200.8 Rev. 5.4
Vanadium, Total	EPA 200.7 Rev. 4.4
	EPA 200.8 Rev. 5.4

Metals III

Calcium, Total	EPA 200.7 Rev. 4.4
Magnesium, Total	EPA 200.7 Rev. 4.4
Potassium, Total	EPA 200.7 Rev. 4.4
Sodium, Total	EPA 200.7 Rev. 4.4

Non-Metals

Alkalinity	SM 18-22 2320B (-97)
Calcium Hardness	EPA 200.7 Rev. 4.4
Chloride	EPA 300.0 Rev. 2.1
Color	SM 18-22 2120B (-01)
Nitrate (as N)	EPA 300.0 Rev. 2.1
Nitrite (as N)	EPA 300.0 Rev. 2.1
Orthophosphate (as P)	EPA 300.0 Rev. 2.1
	SM 18-22 4500-P E (-99)
Solids, Total Dissolved	SM 18-22 2540C (-97)
Specific Conductance	EPA 120.1 Rev. 1982

Serial No.: 54046

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2017
Issued April 01, 2016

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. ROBERT Q. BRADLEY
YORK ANALYTICAL LABORATORIES INC
120 RESEARCH DRIVE
STRATFORD, CT 06615

NY Lab Id No: 10854

*is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2003) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:*

Non-Metals

Sulfate (as SO₄) EPA 300.0 Rev. 2.1

Trihalomethanes

Bromodichloromethane EPA 524.2

Bromoform EPA 524.2

Chloroform EPA 524.2

Dibromochloromethane EPA 524.2

Volatile Aromatics

1,2,3-Trichlorobenzene EPA 524.2

1,2,4-Trichlorobenzene EPA 524.2

1,2,4-Trimethylbenzene EPA 524.2

1,2-Dichlorobenzene EPA 524.2

1,3,5-Trimethylbenzene EPA 524.2

1,3-Dichlorobenzene EPA 524.2

1,4-Dichlorobenzene EPA 524.2

2-Chlorotoluene EPA 524.2

4-Chlorotoluene EPA 524.2

Benzene EPA 524.2

Bromobenzene EPA 524.2

Chlorobenzene EPA 524.2

Ethyl benzene EPA 524.2

Hexachlorobutadiene EPA 524.2

Isopropylbenzene EPA 524.2

n-Butylbenzene EPA 524.2

n-Propylbenzene EPA 524.2

p-Isopropyltoluene (P-Cymene) EPA 524.2

Volatile Aromatics

sec-Butylbenzene EPA 524.2

Styrene EPA 524.2

tert-Butylbenzene EPA 524.2

Toluene EPA 524.2

Total Xylenes EPA 524.2

Volatile Halocarbons

1,1,1,2-Tetrachloroethane EPA 524.2

1,1,1-Trichloroethane EPA 524.2

1,1,2,2-Tetrachloroethane EPA 524.2

1,1,2-Trichloroethane EPA 524.2

1,1-Dichloroethane EPA 524.2

1,1-Dichloroethene EPA 524.2

1,1-Dichloropropene EPA 524.2

1,2,3-Trichloropropane EPA 524.2

1,2-Dichloroethane EPA 524.2

1,2-Dichloropropane EPA 524.2

1,3-Dichloropropane EPA 524.2

2,2-Dichloropropane EPA 524.2

Bromochloromethane EPA 524.2

Bromomethane EPA 524.2

Carbon tetrachloride EPA 524.2

Chloroethane EPA 524.2

Chloromethane EPA 524.2

cis-1,2-Dichloroethene EPA 524.2

cis-1,3-Dichloropropene EPA 524.2

Serial No.: 54046

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.



NEW YORK STATE DEPARTMENT OF HEALTH
WADSWORTH CENTER



Expires 12:01 AM April 01, 2017
Issued April 01, 2016

CERTIFICATE OF APPROVAL FOR LABORATORY SERVICE

Issued in accordance with and pursuant to section 502 Public Health Law of New York State

MR. ROBERT Q. BRADLEY
YORK ANALYTICAL LABORATORIES INC
120 RESEARCH DRIVE
STRATFORD, CT 06615

NY Lab Id No: 10854

is hereby APPROVED as an Environmental Laboratory in conformance with the
National Environmental Laboratory Accreditation Conference Standards (2003) for the category
ENVIRONMENTAL ANALYSES POTABLE WATER
All approved analytes are listed below:

Volatile Halocarbons

Dibromomethane	EPA 524.2
Dichlorodifluoromethane	EPA 524.2
Methylene chloride	EPA 524.2
Tetrachloroethene	EPA 524.2
trans-1,2-Dichloroethene	EPA 524.2
trans-1,3-Dichloropropene	EPA 524.2
Trichloroethene	EPA 524.2
Trichlorofluoromethane	EPA 524.2
Vinyl chloride	EPA 524.2

Serial No.: 54046

Property of the New York State Department of Health. Certificates are valid only at the address shown, must be conspicuously posted, and are printed on secure paper. Continued accreditation depends on successful ongoing participation in the Program. Consumers are urged to call (518) 485-5570 to verify the laboratory's accreditation status.

